


NFPA® 1710

Standard for the Organization and Deployment of Fire Suppression Operations, Emergency Medical Operations, and Special Operations to the Public by Career Fire Departments

2016 Edition



NFPA, 1 Batterymarch Park, Quincy, MA 02169-7471
An International Codes and Standards Organization

8 June

IMPORTANT NOTICES AND DISCLAIMERS CONCERNING NFPA® STANDARDS

NOTICE AND DISCLAIMER OF LIABILITY CONCERNING THE USE OF NFPA STANDARDS

NFPA® codes, standards, recommended practices, and guides ("NFPA Standards"), of which the document contained herein is one, are developed through a consensus standards development process approved by the American National Standards Institute. This process brings together volunteers representing varied viewpoints and interests to achieve consensus on fire and other safety issues. While the NFPA administers the process and establishes rules to promote fairness in the development of consensus, it does not independently test, evaluate, or verify the accuracy of any information or the soundness of any judgments contained in NFPA Standards.

The NFPA disclaims liability for any personal injury, property or other damages of any nature whatsoever, whether special, indirect, consequential or compensatory, directly or indirectly resulting from the publication, use of, or reliance on NFPA Standards. The NFPA also makes no guaranty or warranty as to the accuracy or completeness of any information published herein.

In issuing and making NFPA Standards available, the NFPA is not undertaking to render professional or other services for or on behalf of any person or entity. Nor is the NFPA undertaking to perform any duty owed by any person or entity to someone else. Anyone using this document should rely on his or her own independent judgment or, as appropriate, seek the advice of a competent professional in determining the exercise of reasonable care in any given circumstances.

The NFPA has no power, nor does it undertake, to police or enforce compliance with the contents of NFPA Standards. Nor does the NFPA list, certify, test, or inspect products, designs, or installations for compliance with this document. Any certification or other statement of compliance with the requirements of this document shall not be attributable to the NFPA and is solely the responsibility of the certifier or maker of the statement.

REMINDER: UPDATING OF NFPA STANDARDS

Users of NFPA codes, standards, recommended practices, and guides ("NFPA Standards") should be aware that NFPA Standards may be amended from time to time through the issuance of Tentative Interim Amendments or corrected by Errata. An official NFPA Standard at any point in time consists of the current edition of the document together with any Tentative Interim Amendment and any Errata then in effect.

In order to determine whether an NFPA Standard has been amended through the issuance of Tentative Interim Amendments or corrected by Errata, visit the Document Information Pages on NFPA's website. The Document Information Pages provide up-to-date, document specific information including any issued Tentative Interim Amendments and Errata.

To access the Document Information Page for a specific NFPA Standard, go to <http://www.nfpa.org/docinfo> to choose from the list of NFPA Standards or use the search feature on the right to select the NFPA Standard number (e.g., NFPA 101). In addition to posting all existing Tentative Interim Amendments and Errata, the Document Information Page also includes the option to sign-up for an "Alert" feature to receive an email notification when new updates and other information are posted regarding the document.

Copyright © 2015 National Fire Protection Association®. All Rights Reserved.

NFPA® 1710

Standard for the

Organization and Deployment of Fire Suppression Operations, Emergency Medical Operations, and Special Operations to the Public by Career Fire Departments

2016 Edition

This edition of NFPA 1710, *Standard for the Organization and Deployment of Fire Suppression Operations, Emergency Medical Operations, and Special Operations to the Public by Career Fire Departments*, was prepared by the Technical Committee on Fire and Emergency Service Organization and Deployment—Career and acted on by NFPA at its June Association Technical Meeting held June 22–25, 2015, in Chicago, IL. It was issued by the Standards Council on August 18, 2015, with an effective date of September 7, 2015, and supersedes all previous editions.

This edition of NFPA 1710 was approved as an American National Standard on September 7, 2015.

Origin and Development of NFPA 1710

In 2001, the first edition of NFPA 1710 was issued. The development of that benchmark standard was the result of a considerable amount of hard work and tenacity by the Technical Committee members and the organizations they represented. That standard was the first organized approach to defining levels of service, deployment capabilities, and staffing levels for substantially career fire departments. Research work and empirical studies in North America were used by the Committee as a basis for developing response times and resource capabilities for those services, as identified by the fire department.

Following the issuance of the first edition, the NFPA Standards Council asked the Technical Committee to begin the revision process for a 2004 edition of the standard. The Committee formed several Task Groups to look at various aspects of the document. However, recognizing that the standard had not been fully field tested, the extent of the changes proposed were minimal with a cleanup of definitions, the addition of wording regarding equivalency in the annex, and clarification that the discussion on rate of fire propagation in the annex involved unsprinklered rooms.

The 2010 edition of NFPA 1710 standardized and refined terminology and definitions used in the document. Particular attention was paid to terminology for time frames for the various events that occur from event initiation to the end of the fire department's involvement with the incident. This included recognition that there is a time interval to initiate action or intervene at the end of travel time and before control and mitigation actually begin. The requirements for time frames for alarm handling were revised to correspond to changes being made to NFPA 1221. The time allowance for turnout for fires and special operations was lengthened to 80 seconds, but the time measurement was defined to start at the beginning of the transmission of response data to the emergency response units or emergency response facilities. All times shown as both minutes and seconds were changed to seconds only because that is the level of precision in which the committee intends time to be measured. An application section was added in Chapter 1. The travel times for units responding on the first alarm were clarified to indicate the first unit must arrive within 4 minutes travel time and all units must arrive within 8 minutes travel time. The quadrennial report required to be provided to the AHJ in the previous edition was changed to an annual report.

The annex material related to the requirement stated for an initial full alarm assignment capability has been moved to the body of the standard to clarify that the requirement applies to a structure fire in a typical 2000 ft² (186m²), two-story single-family dwelling without basement and with no exposures. In addition, wording was added to require additional resources be deployed on fires in occupancies that present hazards greater than the two-story single-family dwelling. The community-wide risk management model that has been in an annex to NFPA 1720 has been added as an annex to NFPA 1710.

IMPORTANT NOTICES AND DISCLAIMERS CONCERNING NFPA® STANDARDS

ADDITIONAL NOTICES AND DISCLAIMERS

Updating of NFPA Standards

Users of NFPA codes, standards, recommended practices, and guides ("NFPA Standards") should be aware that these documents may be superseded at any time by the issuance of new editions or may be amended from time to time through the issuance of Tentative Interim Amendments or corrected by Errata. An official NFPA Standard at any point in time consists of the current edition of the document together with any Tentative Interim Amendments and any Errata then in effect. In order to determine whether a given document is the current edition and whether it has been amended through the issuance of Tentative Interim Amendments or corrected through the issuance of Errata, consult appropriate NFPA publications such as the National Fire Codes® Subscription Service, visit the NFPA website at www.nfpa.org, or contact the NFPA at the address listed below.

Interpretations of NFPA Standards

A statement, written or oral, that is not processed in accordance with Section 6 of the Regulations Governing the Development of NFPA Standards shall not be considered the official position of NFPA or any of its Committees and shall not be considered to be, nor be relied upon as, a Formal Interpretation.

Patents

The NFPA does not take any position with respect to the validity of any patent rights referenced in, related to, or asserted in connection with an NFPA Standard. The users of NFPA Standards bear the sole responsibility for determining the validity of any such patent rights, as well as the risk of infringement of such rights, and the NFPA disclaims liability for the infringement of any patent resulting from the use of or reliance on NFPA Standards.

NFPA adheres to the policy of the American National Standards Institute (ANSI) regarding the inclusion of patents in American National Standards ("the ANSI Patent Policy"), and hereby gives the following notice pursuant to that policy:

NOTICE: The user's attention is called to the possibility that compliance with an NFPA Standard may require use of an invention covered by patent rights. NFPA takes no position as to the validity of any such patent rights or as to whether such patent rights constitute or include essential patent claims under the ANSI Patent Policy. If, in connection with the ANSI Patent Policy, a patent holder has filed a statement of willingness to grant licenses under these rights on reasonable and nondiscriminatory terms and conditions to applicants desiring to obtain such a license, copies of such filed statements can be obtained, on request, from NFPA. For further information, contact the NFPA at the address listed below.

Law and Regulations

Users of NFPA Standards should consult applicable federal, state, and local laws and regulations. NFPA does not, by the publication of its codes, standards, recommended practices, and guides, intend to urge action that is not in compliance with applicable laws, and these documents may not be construed as doing so.

Copyrights

NFPA Standards are copyrighted. They are made available for a wide variety of both public and private uses. These include both use, by reference, in laws and regulations, and use in private self-regulation, standardization, and the promotion of safe practices and methods. By making these documents available for use and adoption by public authorities and private users, the NFPA does not waive any rights in copyright to these documents.

Use of NFPA Standards for regulatory purposes should be accomplished through adoption by reference. The term "adoption by reference" means the citing of title, edition, and publishing information only. Any deletions, additions, and changes desired by the adopting authority should be noted separately in the adopting instrument. In order to assist NFPA in following the uses made of its documents, adopting authorities are requested to notify the NFPA (Attention: Secretary, Standards Council) in writing of such use. For technical assistance and questions concerning adoption of NFPA Standards, contact NFPA at the address below.

For Further Information

All questions or other communications relating to NFPA Standards and all requests for information on NFPA procedures governing its codes and standards development process, including information on the procedures for requesting Formal Interpretations, for proposing Tentative Interim Amendments, and for proposing revisions to NFPA standards during regular revision cycles, should be sent to NFPA headquarters, addressed to the attention of the Secretary, Standards Council, NFPA, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101; email: stds_admin@nfpa.org

For more information about NFPA, visit the NFPA website at www.nfpa.org. All NFPA codes and standards can be viewed at no cost at www.nfpa.org/freeaccess.

1710-2 ORGANIZATION AND DEPLOYMENT OF FIRE SUPPRESSION OPERATIONS BY CAREER FIRE DEPARTMENTS

The work done by the Committee provided the user with a template for developing an implementation plan on the standard. Most important, it provided the body politic and citizens a true picture of the risks in their communities and the fire departments' capabilities to respond to and manage those risks.

In the 2016 edition, the Committee has added three new occupancies and the appropriate response staffing levels for garden-style apartment, open-air strip mall, and high-rise occupancies. In addition, redundant text has been removed, and some language has been clarified.

James M. Thompson, Fire Chief, Valley Fire Department, MO (U)
Thomas C. Janssen, Captain, Fire Department, AL (E)
Kathleen E. Janssen, Insurance Services Officer, AL (U)
Curtis L. Janssen, U.S. Department of Homeland Security, MD (E)
Frank J. Janssen, United Firefighters of Los Angeles City, CA (U)
Michael J. Janssen, City of Cape Coral Fire Department, FL (U)
Gary J. Janssen, Fire Department, FL (U)
Frank J. Janssen, City of Fairfax Fire Department, VA (E)
Chris J. Janssen, Association des Pompiers de Montreal Inc., Canada (U)
Mark A. Janssen, Ohio Association of Firefighters, OH (U)
Joseph J. Janssen, WAF Local 85, VA (U)
James J. Janssen, Fire Department, AL (U)
L. Charles Janssen, University of Florida, FL (E)
Frank M. Janssen, U.S. Department of Energy, TN (U)
Gustavo J. Janssen, The Green Group LLC, MD (E)
Frank J. Janssen, Fire Department, AL (U)
Frank J. Janssen, Fire Department, AL (U)
Frank J. Janssen, Fire Department, AL (U)

William J. Janssen, Captain, FL (U)
Fire Department, AL (U)
Paul R. Janssen, Captain, Fire Department, AL (U)
Michael E. Janssen, Fire Department, AL (U)
Chris W. Janssen, Fire Department, AL (U)
Fire Department, AL (U)
Frank J. Janssen, Fire Department, AL (U)
Frank J. Janssen, Fire Department, AL (U)
Frank J. Janssen, Fire Department, AL (U)
Frank J. Janssen, Fire Department, AL (U)
Frank J. Janssen, Fire Department, AL (U)
Frank J. Janssen, Fire Department, AL (U)
Frank J. Janssen, Fire Department, AL (U)
Frank J. Janssen, Fire Department, AL (U)
Frank J. Janssen, Fire Department, AL (U)
Frank J. Janssen, Fire Department, AL (U)

Frank J. Janssen, Fire Department, AL (U)
Frank J. Janssen, Fire Department, AL (U)
Frank J. Janssen, Fire Department, AL (U)
Frank J. Janssen, Fire Department, AL (U)
Frank J. Janssen, Fire Department, AL (U)
Frank J. Janssen, Fire Department, AL (U)
Frank J. Janssen, Fire Department, AL (U)
Frank J. Janssen, Fire Department, AL (U)
Frank J. Janssen, Fire Department, AL (U)
Frank J. Janssen, Fire Department, AL (U)
Frank J. Janssen, Fire Department, AL (U)
Frank J. Janssen, Fire Department, AL (U)
Frank J. Janssen, Fire Department, AL (U)
Frank J. Janssen, Fire Department, AL (U)
Frank J. Janssen, Fire Department, AL (U)

Michael J. Janssen, Fire Department, AL (U)
Frank J. Janssen, Fire Department, AL (U)
Frank J. Janssen, Fire Department, AL (U)
Frank J. Janssen, Fire Department, AL (U)
Frank J. Janssen, Fire Department, AL (U)
Frank J. Janssen, Fire Department, AL (U)
Frank J. Janssen, Fire Department, AL (U)
Frank J. Janssen, Fire Department, AL (U)
Frank J. Janssen, Fire Department, AL (U)
Frank J. Janssen, Fire Department, AL (U)
Frank J. Janssen, Fire Department, AL (U)
Frank J. Janssen, Fire Department, AL (U)
Frank J. Janssen, Fire Department, AL (U)
Frank J. Janssen, Fire Department, AL (U)
Frank J. Janssen, Fire Department, AL (U)

Frank J. Janssen, Fire Department, AL (U)
Frank J. Janssen, Fire Department, AL (U)
Frank J. Janssen, Fire Department, AL (U)
Frank J. Janssen, Fire Department, AL (U)
Frank J. Janssen, Fire Department, AL (U)
Frank J. Janssen, Fire Department, AL (U)
Frank J. Janssen, Fire Department, AL (U)
Frank J. Janssen, Fire Department, AL (U)
Frank J. Janssen, Fire Department, AL (U)
Frank J. Janssen, Fire Department, AL (U)
Frank J. Janssen, Fire Department, AL (U)
Frank J. Janssen, Fire Department, AL (U)
Frank J. Janssen, Fire Department, AL (U)
Frank J. Janssen, Fire Department, AL (U)
Frank J. Janssen, Fire Department, AL (U)



Technical Committee on Fire and Emergency Service Organization and Deployment-Career

William W. Bryson, Chair

Pembroke Pines, FL [E]

Rep. Metropolitan Fire Chiefs-IAFC/NFPA

William L. Bingham, Galena, IL [U]

Rep. International Fire Marshals Association

Paul D. Brooks, Center for Public Safety Excellence, VA [SE]

Michael R. Brown, Washington State Association of Fire Chiefs, WA [E]

Rep. International Association of Fire Chiefs

Randy R. Bruegman, City of Anaheim Fire Department, CA [E]

Rep. International Association of Fire Chiefs

Alan V. Brunacini, Fire Command Seminars, AZ [SE]

John J. Caussin, Fairfax County Fire & Rescue Department, VA [E]

Robert J. Crawford, Municipality of Chatham-Kent, Canada [E]

Rep. NFPA Fire Service Section

Frank De Clercq, City of San Diego Fire-Rescue Department, CA [L]

Rep. International Association of Fire Fighters

Daniel J. Greensweig, League of Minnesota Cities, MN [C]

Rep. National League of Cities

Thomas Hanify, The Professional Firefighters Union of Indiana, IN [L]

Rep. International Association of Fire Fighters

Todd A. Harms, Phoenix Fire Department, AZ [E]

Jason M. Hoevelmann, Florissant Valley Fire Protection District, MO [U]

Thomas C. Jenkins, Rogers Fire Department, AR [E]

Kevin P. Kuntz, Insurance Services Office, Inc., NJ [I]

Cortez Lawrence, U.S. Department of Homeland Security, MD [SE]

Frank Lima, United Firefighters of Los Angeles City, CA [L]

Michael Merchan, City of Cape Coral Fire Rescue, FL [U]

Gary Rainey, Florida Professional Firefighters, FL [L]

David L. Rohr, City of Fairfax Fire Department, VA [E]

Chris Ross, Association des Pompiers de Montreal Inc., Canada [L]

Mark A. Sanders, Ohio Association of Professional Firefighters, OH [L]

Joseph Schulle, IAFF Local 22, PA [L]

Rep. International Association of Fire Fighters

James L. Silvernail, Metro West Fire Protection District, MO [U]

L. Charles Smeby, University of Florida, FL [SE]

Patrick N. Smith, U.S. Department of Energy, TN [U]

Catherine L. Spain, The Spain Group LLC, MD [C]

Rep. National League of Cities

Donald H. J. Turno, Savannah River Nuclear Solutions, LLC, SC [U]

J. Curtis Varone, Public Agency Training Council, RI [SE]

Alternates

Michael S. Digman, Metro West Fire Protection District, MO [U]

(Alt. to J. L. Silvernail)

Anne M. Finn, League of Minnesota Cities, MN [C]

(Alt. to D. J. Greensweig)

Anthony Gamboa, United Firefighters of Los Angeles City, CA [L]

(Alt. to F. Lima)

William A. Garrett, Fairfax County Fire & Rescue Department, VA [E]

(Alt. to J. J. Caussin)

Brian D. Goss, Brentwood Fire & Rescue Department, TN [E]

(Alt. to R. R. Bruegman)

Michael D. Masters, Oak Ridge National Laboratory (USDOE), TN [U]

(Alt. to P. N. Smith)

Kevin McDonald, Springdale Fire Department, AR [E]

(Alt. to T. C. Jenkins)

Patrick J. Morrison, International Association of Fire Fighters, DC [L]

(Alt. to T. Hanify)

Richard D. Riley, Clearwater Fire & Rescue, FL [E]

(Alt. to M. R. Brown)

Andrew J. Vita, City of Fairfax Fire Department, VA [E]

(Alt. to D. L. Rohr)

Jimm Walsh, Winter Park Fire Department, FL [U]

(Alt. to W. L. Bingham)

Thomas J. Wiczorek, International City/County Management Assn., DC [E]

(Voting Alt. to ICMA Rep.)

Steven F. Sawyer, NFPA Staff Liaison

This list represents the membership at the time the Committee was balloted on the final text of this edition. Since that time, changes in the membership may have occurred. A key to classifications is found at the back of the document.

NOTE: Membership on a committee shall not in and of itself constitute an endorsement of the Association or any document developed by the committee on which the member serves.

Committee Scope: This Committee shall have primary responsibility for documents on the organization, operation, deployment, and evaluation of substantially all career public fire protection and emergency medical services.

1710-4 ORGANIZATION AND DEPLOYMENT OF FIRE SUPPRESSION OPERATIONS BY CAREER FIRE DEPARTMENTS

Contents

Chapter 1 Administration	1710- 5	4.7 Wildland Fire Suppression Services	1710- 9
1.1 Scope	1710- 5	4.8 Intercommunity Organization	1710- 9
1.2 Purpose	1710- 5	Chapter 5 Fire Department Services	1710-10
1.3 Application	1710- 5	5.1 Purpose	1710-10
1.4 Equivalency	1710- 5	5.2 Fire Suppression Services	1710-10
Chapter 2 Referenced Publications	1710- 5	5.3 Emergency Medical Services (EMS)	1710-12
2.1 General	1710- 5	5.4 Special Operations Response	1710-13
2.2 NFPA Publications	1710- 5	5.5 Airport Rescue and Fire-Fighting (ARFF) Services	1710-13
2.3 Other Publications	1710- 5	5.6 Marine Rescue and Fire-Fighting (MRFF) Services	1710-14
2.4 References for Extracts in Mandatory Sections	1710- 6	5.7 Wildland Fire Suppression Services	1710-14
Chapter 3 Definitions	1710- 6	Chapter 6 Systems	1710-15
3.1 General	1710- 6	6.1 Safety and Health System	1710-15
3.2 NFPA Official Definitions	1710- 6	6.2 Incident Management System	1710-15
3.3 General Definitions	1710- 6	6.3 Training Systems	1710-15
Chapter 4 Organization	1710- 8	6.4 Communications Systems	1710-16
4.1 Fire Department Organizational Statement	1710- 8	6.5 Pre-Incident Planning	1710-16
4.2 Fire Suppression Services	1710- 9	Annex A Explanatory Material	1710-16
4.3 Emergency Medical Services	1710- 9	Annex B Community-Wide Risk Management Model	1710-21
4.4 Special Operations	1710- 9	Annex C Informational References	1710-23
4.5 Airport Rescue and Fire-Fighting Services	1710- 9	Index	1710-25
4.6 Marine Rescue and Fire-Fighting Services	1710- 9		



NFPA 1710

Standard for the

Organization and Deployment of Fire Suppression Operations, Emergency Medical Operations, and Special Operations to the Public by Career Fire Departments

2016 Edition

IMPORTANT NOTE: This NFPA document is made available for use subject to important notices and legal disclaimers. These notices and disclaimers appear in all publications containing this document and may be found under the heading "Important Notices and Disclaimers Concerning NFPA Standards." They can also be obtained on request from NFPA or viewed at www.nfpa.org/disclaimers.

UPDATES, ALERTS, AND FUTURE EDITIONS: New editions of NFPA codes, standards, recommended practices, and guides (i.e., NFPA Standards) are released on scheduled revision cycles. This edition may be superseded by a later one, or it may be amended outside of its scheduled revision cycle through the issuance of Tentative Interim Amendments (TIAs). An official NFPA Standard at any point in time consists of the current edition of the document, together with any TIAs and Errata in effect. To verify that this document is the current edition or to determine if it has been amended by any TIAs or Errata, please consult the National Fire Codes® Subscription Service or visit the Document Information (DocInfo) pages on the NFPA website at www.nfpa.org/docinfo. In addition to TIAs and Errata, the DocInfo pages also include the option to sign up for Alerts for each document and to be involved in the development of the next edition.

NOTICE: An asterisk (*) following the number or letter designating a paragraph indicates that explanatory material on the paragraph can be found in Annex A.

A reference in brackets [] following a section or paragraph indicates material that has been extracted from another NFPA document. As an aid to the user, the complete title and edition of the source documents for extracts in mandatory sections of the document are given in Chapter 2 and those for extracts in informational sections are given in Annex C. Extracted text may be edited for consistency and style and may include the revision of internal paragraph references and other references as appropriate. Requests for interpretations or revisions of extracted text shall be sent to the technical committee responsible for the source document.

Information on referenced publications can be found in Chapter 2 and Annex C.

Chapter 1 Administration

1.1* Scope. This standard contains minimum requirements relating to the organization and deployment of fire suppression operations, emergency medical operations, and special operations to the public by substantially all career fire departments.

1.1.1 The requirements address functions and objectives of fire department emergency service delivery, response capabilities, and resources.

1.1.2 This standard also contains general requirements for managing resources and systems, such as health and safety,

incident management, training, communications, and pre-incident planning.

1.1.3 This standard addresses the strategic and system issues involving the organization, operation, and deployment of a fire department and does not address tactical operations at a specific emergency incident.

1.2 Purpose.

1.2.1* The purpose of this standard is to specify the minimum criteria addressing the effectiveness and efficiency of the career public fire suppression operations, emergency medical service, and special operations delivery in protecting the citizens of the jurisdiction and the occupational safety and health of fire department employees.

1.2.2 Nothing herein is intended to restrict any jurisdiction from exceeding these minimum requirements.

1.3 Application.

1.3.1 This standard applies to the deployment of resources by a fire department to emergency situations when operations can be implemented to save lives and property.

1.3.2 The standard is a benchmark for most common responses and a platform for developing the appropriate plan for deployment of resources for fires in higher hazard occupancies or more complex incidents.

1.4* Equivalency. Nothing in this standard is intended to prohibit the use of systems, methods, or approaches of equivalent or superior performance to those prescribed by this standard, provided technical documentation is submitted to the authority having jurisdiction to demonstrate equivalency.

Chapter 2 Referenced Publications

2.1 General. The documents or portions thereof listed in this chapter are referenced within this standard and shall be considered part of the requirements of this document.

2.2 NFPA Publications. National Fire Protection Association, 1 Batterymarch Park, Quincy, MA 02169-7471.

NFPA 403, *Standard for Aircraft Rescue and Fire-Fighting Services at Airports*, 2014 edition.

NFPA 472, *Standard for Competence of Responders to Hazardous Materials/Weapons of Mass Destruction Incidents*, 2013 edition.

NFPA 1143, *Standard for Wildland Fire Management*, 2014 edition.

NFPA 1221, *Standard for the Installation, Maintenance, and Use of Emergency Services Communications Systems*, 2016 edition.

NFPA 1500, *Standard on Fire Department Occupational Safety and Health Program*, 2013 edition.

NFPA 1561, *Standard on Emergency Services Incident Management System and Command Safety*, 2014 edition.

NFPA 1670, *Standard on Operations and Training for Technical Search and Rescue Incidents*, 2014 edition.

2.3 Other Publications.

2.3.1 U.S. Government Publications. U.S. Government Publishing Office, Washington, DC 20402.

Title 29, Code of Federal Regulations, Part 1910.120, "Hazardous Waste Operations and Emergency Response."

Title 29, Code of Federal Regulations, Part 1910.146, "Permit-Required Confined Space."

2.3.2 Other Publications.

Merriam-Webster's Collegiate Dictionary, 11th edition, Merriam-Webster, Inc., Springfield, MA, 2003.

2.4 References for Extracts in Mandatory Sections.

NFPA 472, *Standard for Competence of Responders to Hazardous Materials/Weapons of Mass Destruction Incidents*, 2013 edition.

NFPA 1002, *Standard for Fire Apparatus Driver/Operator Professional Qualifications*, 2014 edition.

NFPA 1081, *Standard for Industrial Fire Brigade Member Professional Qualifications*, 2012 edition.

NFPA 1142, *Standard on Water Supplies for Suburban and Rural Fire Fighting*, 2012 edition.

NFPA 1221, *Standard for the Installation, Maintenance, and Use of Emergency Services Communications Systems*, 2016 edition.

NFPA 1500, *Standard on Fire Department Occupational Safety and Health Program*, 2013 edition.

NFPA 1521, *Standard for Fire Department Safety Officer Professional Qualifications*, 2015 edition.

NFPA 1561, *Standard on Emergency Services Incident Management System and Command Safety*, 2014 edition.

NFPA 1901, *Standard for Automotive Fire Apparatus*, 2016 edition.

Chapter 3 Definitions

3.1 General. The definitions contained in this chapter shall apply to the terms used in this standard. Where terms are not defined in this chapter or within another chapter, they shall be defined using their ordinarily accepted meanings within the context in which they are used. *Merriam-Webster's Collegiate Dictionary*, 11th edition, shall be the source for the ordinarily accepted meaning.

3.2 NFPA Official Definitions.

3.2.1* Approved. Acceptable to the authority having jurisdiction.

3.2.2* Authority Having Jurisdiction (AHJ). An organization, office, or individual responsible for enforcing the requirements of a code or standard, or for approving equipment, materials, an installation, or a procedure.

3.2.3 Shall. Indicates a mandatory requirement.

3.2.4 Should. Indicates a recommendation or that which is advised but not required.

3.2.5 Standard. An NFPA Standard, the main text of which contains only mandatory provisions using the word "shall" to indicate requirements and that is in a form generally suitable for mandatory reference by another standard or code or for adoption into law. Nonmandatory provisions are not to be considered a part of the requirements of a standard and shall be located in an appendix, annex, footnote, informational note, or other means as permitted in the NFPA Manuals of Style. When used in a generic sense, such as in the phrase "standards development process" or "standards development activities," the term "standards" includes all NFPA Standards, including Codes, Standards, Recommended Practices, and Guides.

3.3 General Definitions.

3.3.1 Advanced Life Support (ALS). See 3.3.36.1.

3.3.2 Aid.

3.3.2.1* Automatic Aid. A plan developed between two or more fire departments for immediate joint response on first alarms. [1142, 2012]

3.3.2.2 Mutual Aid. A written intergovernmental agreement between agencies and/or jurisdictions that they will assist one another on request by furnishing personnel, equipment, and/or expertise in a specified manner.

3.3.3 Aircraft Rescue and Fire Fighting. See 3.3.21.1.

3.3.4* Aircraft Rescue and Fire-Fighting (ARFF) Vehicle. A vehicle intended to carry rescue and fire-fighting equipment for rescuing occupants and combating fires in aircraft at, or in the vicinity of, an airport. [1002, 2014]

3.3.5* Alarm. A signal or message from a person or device indicating the existence of an emergency or other situation that requires action by an emergency response agency. [1221, 2016]

3.3.6 Alarm Answering Time. See 3.3.53.1.

3.3.7 Alarm Handling Time. See 3.3.53.2.

3.3.8 Alarm Processing Time. See 3.3.53.3.

3.3.9 Alarm Transfer Time. See 3.3.53.4.

3.3.10 Apparatus.

3.3.10.1 Fire Apparatus. A vehicle designed to be used under emergency conditions to transport personnel and equipment, and to support the suppression of fires and mitigation of other hazardous situations. [1901, 2016]

3.3.10.2 Quint Apparatus. A fire apparatus with a permanently mounted fire pump, a water tank, a hose storage area, an aerial device with a permanently mounted waterway, and a complement of ground ladders.

3.3.10.3 Specialized Apparatus. A fire apparatus or vehicle that is used for support or specialized equipment and services at emergency scenes for functions such as, but not limited to, command, technical rescue, hazardous materials mitigation, urban search and rescue, air supply, electrical generation and lighting, or transport of equipment and personnel.

3.3.11 Automatic Aid. See 3.3.2.1.

3.3.12 Basic Life Support (BLS). See 3.3.36.2.

3.3.13* Company. A group of members: (1) under the direct supervision of an officer; (2) trained and equipped to perform assigned tasks; (3) usually organized and identified as engine companies, ladder companies, rescue companies, squad companies, or multi-functional companies; (4) operating with one piece of fire apparatus (pumper, aerial fire apparatus, elevating platform, quint, rescue, squad, ambulance) except where multiple apparatus are assigned that are dispatched and arrive together, continuously operate together, and are managed by a single company officer; (5) arriving at the incident scene on fire apparatus. [1500, 2013]

3.3.14 Company Officer. See 3.3.40.1.

3.3.15 Crew. See 3.3.52, Team.

3.3.16 Emergency Incident. Any situation to which an emergency services organization responds to deliver emergency services, including rescue, fire suppression, emergency medical



care, special operations, law enforcement, and other forms of hazard control and mitigation. [1561, 2014]

3.3.17 Emergency Medical Care. The treatment of patients using first aid, cardiopulmonary resuscitation, basic life support, advanced life support, and other medical procedures prior to arrival at a hospital or other health care facility.

3.3.18 Emergency Operations. See 3.3.41.1.

3.3.19 Fire Apparatus. See 3.3.10.1.

3.3.20 Fire Department Member. See 3.3.38, Member.

3.3.21 Fire Fighting.

3.3.21.1* Aircraft Rescue and Fire Fighting. The fire-fighting actions taken to rescue persons and to control or extinguish fire involving or adjacent to aircraft on the ground. [1500, 2013]

3.3.21.2* Marine Rescue and Fire Fighting. The fire-fighting action taken to prevent, control, or extinguish fire involved in or adjacent to a marine vessel and the rescue actions for occupants using normal and emergency routes for egress.

3.3.21.3 Structural Fire Fighting. The activities of rescue, fire suppression, and property conservation in buildings or other structures, vehicles, rail cars, marine vessels, aircraft, or like properties.

3.3.22 Fire Protection. Methods of providing fire detection, control, and extinguishment.

3.3.23* Fire Suppression. The activities involved in controlling and extinguishing fires. [1500, 2013]

3.3.24* First Responder (EMS). Functional provision of initial assessment (i.e., airway, breathing, and circulatory systems) and basic first-aid intervention, including CPR and automatic external defibrillator (AED) capability.

3.3.25 Forcible Entry. Techniques used by fire personnel to gain entry into buildings, vehicles, aircraft, or other areas of confinement when normal means of entry are locked or blocked.

3.3.26* Hazard. A condition that presents the potential for harm or damage to people, property, or the environment.

3.3.27 Hazardous Material. A substance that is capable of creating harm to people, the environment, or property due to its toxicity, chemical reactivity, decomposition, or corrosivity; is capable of explosion or detonation; or presents etiological hazards, whether used for its intended purpose or as a weapon of mass destruction (WMD) or for illicit labs purposes, environmental crimes, or industrial sabotage.

3.3.28* High-Hazard Occupancy. An occupancy that presents a high life hazard or large fire potential due to its construction, configuration, or the presence of specific materials, processes, or contents.

3.3.29 Incident Commander. The member responsible for all incident activities, including the development of strategies and tactics and the ordering and the release of resources. [472, 2013]

3.3.30* Incident Management System (IMS). An organized system that defines the roles and responsibilities to be assumed by responders and the standard operating procedures to be used in the management and direction of emergency incidents and other functions.

3.3.31 Incident Safety Officer. See 3.3.40.2.

3.3.32 Initial Full Alarm Assignment. Those personnel, equipment, and resources ordinarily dispatched upon notification of a structure fire.

3.3.33 Initial Rapid Intervention Crew (IRIC). See 3.3.44.1.

3.3.34 Initiating Action/Intervention Time. See 3.3.53.5.

3.3.35 Intergovernmental Agreement. A written formal authorization for services between two or more jurisdictions.

3.3.36 Life Support.

3.3.36.1 Advanced Life Support (ALS). Emergency medical treatment beyond basic life support that provides for advanced airway management including intubation, advanced cardiac monitoring, defibrillation, establishment and maintenance of intravenous access, and drug therapy.

3.3.36.2* Basic Life Support (BLS). A specific level of pre-hospital medical care provided by trained responders, focused on rapidly evaluating a patient's condition; maintaining a patient's airway, breathing, and circulation; controlling external bleeding; preventing shock; and preventing further injury or disability by immobilizing potential spinal or other bone fractures.

3.3.37 Marine Rescue and Fire Fighting. See 3.3.21.2.

3.3.38* Member. A person involved in performing the duties and responsibilities of a fire department, under the auspices of the organization. [1500, 2013]

3.3.39 Mutual Aid. See 3.3.2.2.

3.3.40 Officer.

3.3.40.1* Company Officer. A supervisor of a crew/company of personnel.

3.3.40.2 Incident Safety Officer. A member of the command staff responsible for monitoring and assessing safety hazards or unsafe situations and for developing measures for ensuring personnel safety.

3.3.40.3* Supervisory Chief Officer. A member whose responsibility is to assume command through a formalized transfer of command process and to allow company officers to directly supervise personnel assigned to them.

3.3.41 Operations.

3.3.41.1 Emergency Operations. Activities of the fire department relating to rescue, fire suppression, emergency medical care, and special operations, including response to the scene of the incident and all functions performed at the scene. [1500, 2013]

3.3.41.2* Special Operations. Those emergency incidents to which the fire department responds that require specific and advanced training and specialized tools and equipment. [1500, 2013]

3.3.42 Public Safety Answering Point (PSAP). A facility in which 9-1-1 calls are answered. [1221, 2016]

3.3.43 Quint Apparatus. See 3.3.10.2.

3.3.44* Rapid Intervention Crew (RIC). A dedicated crew of fire fighters who are assigned for rapid deployment to rescue lost or trapped members.

3.3.44.1 Initial Rapid Intervention Crew (IRIC). Two members of the initial attack crew who are assigned for rapid deployment to rescue lost or trapped members.

3.3.45 Rescue. Those activities directed at locating endangered persons at an emergency incident, removing those persons from danger, treating the injured, and providing for transport to an appropriate health care facility. [1500, 2013]

3.3.46 Special Operations. See 3.3.41.2.

3.3.47 Specialized Apparatus. See 3.3.10.3.

3.3.48* Staff Aide. A fire fighter or fire officer assigned to a supervisory chief officer to assist with the logistical, tactical, and accountability functions of incident, division, or sector command.

3.3.49 Standard Operating Procedure. A written organizational directive that establishes or prescribes specific operational or administrative methods to be followed routinely for the performance of designated operations or actions. [1521, 2015]

3.3.50 Structural Fire Fighting. See 3.3.21.3.

3.3.51 Supervisory Chief Officer. See 3.3.40.3.

3.3.52 Team. Two or more members who have been assigned a common task and are in communication with each other, coordinate their activities as a work group, and support the safety of one another. [1081, 2012]

3.3.53 Time.

3.3.53.1 Alarm Answering Time. The time interval that begins when the alarm is received at the communication center and ends when the alarm is acknowledged at the communication center.

3.3.53.2 Alarm Handling Time. The time interval from the receipt of the alarm at the primary PSAP until the beginning of the transmittal of the response information via voice or electronic means to emergency response facilities (ERFs) or the emergency response units (ERUs) in the field.

3.3.53.3 Alarm Processing Time. The time interval from when the alarm is acknowledged at the communication center until response information begins to be transmitted via voice or electronic means to emergency response facilities (ERFs) and emergency response units (ERUs).

3.3.53.4 Alarm Transfer Time. The time interval from the receipt of the emergency alarm at the PSAP until the alarm is first received at the communication center.

3.3.53.5* Initiating Action/Intervention Time. The time interval from when a unit arrives on the scene to the initiation of emergency mitigation.

3.3.53.6* Total Response Time. The time interval from the receipt of the alarm at the primary PSAP to when the first emergency response unit is initiating action or intervening to control the incident.

3.3.53.7 Travel Time. The time interval that begins when a unit is en route to the emergency incident and ends when the unit arrives at the scene.

3.3.53.8 Turnout Time. The time interval that begins when the emergency response facilities (ERFs) and emergency response units (ERUs) notification process begins by

either an audible alarm or visual annunciation or both and ends at the beginning point of travel time.

3.3.54 Total Response Time. See 3.3.53.6.

3.3.55 Travel Time. See 3.3.53.7.

3.3.56 Turnout Time. See 3.3.53.8.

Chapter 4 Organization

4.1 Fire Department Organizational Statement.

4.1.1* The authority having jurisdiction (AHJ) shall maintain a written statement or policy that establishes the following:

- (1) Existence of the fire department
- (2) Services that the fire department is required to provide
- (3) Basic organizational structure
- (4) Expected number of fire department members
- (5) Functions that fire department members are expected to perform

4.1.2* The fire department organizational statement shall provide service delivery objectives, including specific time objectives for each major service component [i.e., fire suppression, emergency medical services (EMS), special operations, aircraft rescue and fire fighting, marine rescue and fire fighting, and/or wildland fire fighting] and objectives for the percentage of responses that meet the time objectives.

4.1.2.1 The fire department shall establish the following objectives:

- (1) Alarm handling time to be completed in accordance with 4.1.2.3.
- (2) 80 seconds turnout time for fire and special operations response and 60 seconds turnout time for EMS response
- (3) *240 seconds or less travel time for the arrival of the first arriving engine company at a fire suppression incident
- (4) For other than high-rise, 480 seconds or less travel time for the deployment of an initial full alarm assignment at a fire suppression incident
- (5) For high-rise, 610 seconds or less travel time for the deployment of an initial full alarm assignment at a fire suppression incident
- (6) 240 seconds or less travel time for the arrival of a unit with first responder with automatic external defibrillator (AED) or higher level capability at an emergency medical incident
- (7) 480 seconds or less travel time for the arrival of an advanced life support (ALS) unit at an emergency medical incident, where this service is provided by the fire department provided a first responder with AED or basic life support (BLS) unit arrived in 240 seconds or less travel time

4.1.2.2 The fire department shall document the initiating action/intervention time.

4.1.2.3 Alarm Handling.

4.1.2.3.1 The fire department shall establish a performance objective of having an alarm answering time of not more than 15 seconds for at least 95 percent of the alarms received and not more than 40 seconds for at least 99 percent of the alarms received, as specified by NFPA 1221.



4.1.2.3.1.1 Any call not answered within 20 seconds shall be routed to a secondary answering (alternate) center if the primary center is full. An alarm should sound if a call is not answered (not processed, just answered) within 60 seconds.

4.1.2.3.2 When the alarm is received at a public safety answering point (PSAP) and transferred to a secondary answering point or communication center, the agency responsible for the PSAP shall establish a performance objective of having an alarm transfer time of not more than 30 seconds for at least 95 percent of all alarms processed, as specified by NFPA 1221.

4.1.2.3.3 The fire department shall establish a performance objective of having an alarm processing time of not more than 64 seconds for at least 90 percent of the alarms and not more than 106 seconds for at least 95 percent of the alarms, as specified by NFPA 1221.

4.1.2.3.3.1 Emergency alarm processing for the following call types shall be completed within 90 seconds 90 percent of the time and within 120 seconds 99 percent of the time:

- (1) Calls requiring emergency medical dispatch questioning and pre-arrival medical instructions
- (2) Calls requiring language translation
- (3) Calls requiring the use of a TTY/TDD device or audio/video relay services
- (4) Calls of criminal activity that require information vital to emergency responder safety prior to dispatching units
- (5) Hazardous material incidents
- (6) Technical rescue
- (7) Calls that require determining the location of the alarm due to insufficient information
- (8) Calls received by text message

4.1.2.4 The fire department shall establish a performance objective of not less than 90 percent for the achievement of each turnout time and travel time objective specified in 4.1.2.1.

4.1.2.5 Evaluations.

4.1.2.5.1* The fire department shall evaluate its level of service and deployment delivery and alarm handling time, turnout time, and travel time objectives on an annual basis.

4.1.2.5.2* The evaluations shall be based on emergency incident data relating to level of service, deployment, and the achievement of each time objective in each geographic area within the jurisdiction of the fire department.

4.1.2.6 The fire department shall provide the AHJ with a written report annually.

4.1.2.6.1 The annual report shall define the geographic areas and/or circumstances in which the requirements of this standard are not being met.

4.1.2.6.2 The annual report shall explain the predictable consequences of these deficiencies and address the steps that are necessary to achieve compliance.

4.2 Fire Suppression Services. The fire department organizational statement shall set forth the criteria for the various types of fire suppression incidents to which the fire department is required to respond.

4.3 Emergency Medical Services.

4.3.1 The fire department organizational statement shall set forth the criteria for the various types of emergency medical

incidents to which the fire department is required and/or expected to respond.

4.3.2 The fire department organizational statement shall ensure that the fire department's emergency medical response capability includes personnel, equipment, and resources to deploy at the first responder level with AED or higher treatment level.

4.3.3 Where emergency medical services beyond the first responder with AED level are provided by another agency or private organization, the AHJ, based on recommendations from the fire department, shall include the minimum staffing, deployment, and response criteria as required in Section 5.3 in the following:

- (1) The fire department organizational statement
- (2) Any contract, service agreement, governmental agreement, or memorandum of understanding between the AHJ and the other agency or private organization

4.4 Special Operations.

4.4.1 The fire department organizational statement shall set forth the criteria for the various types of special operations response and mitigation activities to which the fire department is required or expected to respond.

4.4.2* The fire department organizational statement shall ensure that the fire department's hazardous materials response capability includes personnel, equipment, and resources to deploy at the first responder operational level as required by 29 CFR 1910.120.

4.4.3 The fire department organizational statement shall ensure that the fire department's confined space response capability includes personnel, equipment, and resources to deploy at the confined space operational level as required by 29 CFR 1910.146.

4.4.4 The fire department organizational statement shall set forth the criteria for the various types of fire department response during natural disasters or terrorism incidents, weapons of mass destruction incidents, or large-scale or mass casualty events.

4.5 Airport Rescue and Fire-Fighting Services. The fire department organizational statement shall set forth the criteria for the various types of airport rescue and fire-fighting incidents to which the fire department is required or expected to respond.

4.6 Marine Rescue and Fire-Fighting Services. The fire department organizational statement shall set forth the criteria for the various types of marine rescue and fire-fighting incidents to which the fire department is required or expected to respond.

4.7 Wildland Fire Suppression Services. The fire department organizational statement shall set forth the criteria for the various types of wildland fire suppression incidents to which the fire department is required and/or expected to respond.

4.8 Intercommunity Organization.

4.8.1* Mutual aid, automatic aid, and fire protection agreements shall be through a written intergovernmental agreement and shall address issues such as liability for injuries and deaths, disability retirements, cost of service, authorization to respond, staffing, and equipment, including the resources to

1710-10 ORGANIZATION AND DEPLOYMENT OF FIRE SUPPRESSION OPERATIONS BY CAREER FIRE DEPARTMENTS

be made available, availability of interoperable communications, and the designation of the incident commander.

4.8.2 Procedures and training of personnel for all fire departments in mutual aid, automatic aid, and fire protection agreement plans shall be comprehensive to produce an effective fire force and to ensure uniform operations.

Chapter 5 Fire Department Services

5.1 Purpose.

5.1.1 The services provided by the fire department shall include those activities identified by the organizational statement developed as required by Chapter 4.

5.1.2 The procedures involved in providing these services, including operations and deployment, shall be established through written administrative regulations, standard operating procedures (SOPs), and departmental orders.

5.2* Fire Suppression Services.

5.2.1 Fire Suppression Capability.

5.2.1.1 Fire suppression operations shall be organized to ensure that the fire department's fire suppression capability encompasses deployment of personnel, equipment, and resources for an initial arriving company, the initial full alarm assignment, and additional alarm assignments.

5.2.1.2 The fire department shall be permitted to use established automatic aid and mutual aid agreements to comply with the requirements of Section 5.2.

5.2.2* Staffing. The number of on-duty fire suppression members shall be sufficient to perform the necessary fire-fighting operations given the expected fire-fighting conditions.

5.2.2.1 These numbers shall be determined through task analyses that take the following factors into consideration:

- (1) Life hazard to the populace protected
- (2) Provisions of safe and effective fire-fighting performance conditions for the fire fighters
- (3) Potential property loss
- (4) Nature, configuration, hazards, and internal protection of the properties involved
- (5) Types of fireground tactics and evolutions employed as standard procedure, type of apparatus used, and results expected to be obtained at the fire scene

5.2.2.2* On-duty members assigned to fire suppression shall be organized into company units and shall have appropriate apparatus and equipment assigned to such companies.

5.2.2.2.1* The fire department shall identify minimum company staffing levels as necessary to meet the deployment criteria required in 5.2.4 to ensure that a sufficient number of members are assigned, on duty, and available to safely and effectively respond with each company.

5.2.2.2.2 Each company shall be led by an officer who shall be considered a part of the company.

5.2.2.2.3* Supervisory chief officers shall be dispatched or notified to respond to all full alarm assignments.

5.2.2.2.4 The supervisory chief officer shall ensure that the incident management system is established as required in Section 6.2.

5.2.2.2.5* Supervisory chief officers shall have staff aides deployed to them for purposes of incident management and accountability at emergency incidents.

5.2.3 Operating Units. Fire company staffing requirements shall be based on minimum levels necessary for safe, effective, and efficient emergency operations.

5.2.3.1 Fire companies whose primary functions are to pump and deliver water and perform basic fire fighting at fires, including search and rescue, shall be known as engine companies.

5.2.3.1.1 These companies shall be staffed with a minimum of four on-duty members.

5.2.3.1.2 In jurisdictions with a high number of incidents or geographical restrictions, as identified by the AHJ, these companies shall be staffed with a minimum of five on-duty members.

5.2.3.1.2.1 In jurisdictions with tactical hazards, high-hazard occupancies, or dense urban areas, as identified by the AHJ, these fire companies shall be staffed with a minimum of six on-duty members.

5.2.3.2 Fire companies whose primary functions are to perform the variety of services associated with truck work, such as forcible entry, ventilation, search and rescue, aerial operations for water delivery and rescue, utility control, illumination, overhaul, and salvage work, shall be known as ladder or truck companies.

5.2.3.2.1 These fire companies shall be staffed with a minimum of four on-duty members.

5.2.3.2.2 In jurisdictions with a high number of incidents or geographical restrictions, as identified by the AHJ, these fire companies shall be staffed with a minimum of five on-duty members.

5.2.3.2.2.1 In jurisdictions with tactical hazards, high-hazard occupancies, or dense urban areas, as identified by the AHJ, these fire companies shall be staffed with a minimum of six on-duty members.

5.2.3.3 Other Types of Companies.

5.2.3.3.1 Other types of companies equipped with specialized apparatus and equipment shall be provided to assist engine and ladder companies where necessary to support the fire departments' SOPs.

5.2.3.3.2 These companies shall be staffed with the minimum number of on-duty members required to deal with the tactical hazards, high-hazard occupancies, high incident frequencies, geographical restrictions, or other pertinent factors as identified by the AHJ.

5.2.3.4 Fire Companies with Quint Apparatus.

5.2.3.4.1 A fire company that deploys with quint apparatus, designed to operate as either an engine company or a ladder company, shall be staffed as specified in 5.2.3.

5.2.3.4.2 If the company is expected to perform multiple roles simultaneously, additional staffing, above the levels specified in 5.2.3, shall be provided to ensure that those operations can be performed as required.

5.2.4 Deployment.

5.2.4.1 Single-Family Dwelling Initial Full Alarm Assignment Capability.

5.2.4.1.1* The initial full alarm assignment to a structure fire in a typical 2000 ft² (186 m²), two-story single-family dwelling

without basement and with no exposures shall provide for the following:

- (1) Establishment of incident command outside of the hazard area for the overall coordination and direction of the initial full alarm assignment with a minimum of one member dedicated to this task
- (2) Establishment of an uninterrupted water supply of a minimum of 400 gpm (1520 L/min) for 30 minutes with supply line(s) maintained by an operator
- (3) Establishment of an effective water flow application rate of 300 gpm (1140 L/min) from two handlines, each of which has a minimum flow rate of 100 gpm (380 L/min) with each handline operated by a minimum of two members to effectively and safely maintain the line
- (4) Provision of one support member for each attack and backup line deployed to provide hydrant hookup and to assist in laying of hose lines, utility control, and forcible entry
- (5) Provision of at least one victim search and rescue team with each such team consisting of a minimum of two members
- (6) Provision of at least one team, consisting of a minimum of two members, to raise ground ladders and perform ventilation
- (7) If an aerial device is used in operations, one member to function as an aerial operator to maintain primary control of the aerial device at all times
- (8) Establishment of an IRIC consisting of a minimum of two properly equipped and trained members

5.2.4.1.2 When an incident escalates beyond an initial full alarm assignment, or when significant risk is present to the member due to the magnitude of the incident, the incident commander shall request an EMS crew consisting of a minimum of two members to provide treatment and transport for injured members and civilians.

5.2.4.1.3 When an incident escalates beyond an initial full alarm assignment or when significant risk is present to the members due to the magnitude of the incident, the incident commander shall upgrade the IRIC to a full rapid intervention crew (s) (RIC) that consists of an officer and at least three members who are fully equipped and trained in RIC operations.

5.2.4.2 Open-Air Strip Shopping Center Initial Full Alarm Assignment Capability.

5.2.4.2.1* The initial full alarm assignment to a structure fire in a typical open-air strip shopping center ranging from 13,000 ft² to 196,000 ft² (1203 m² to 18,209 m²) in size shall provide for the following:

- (1) Establishment of incident command outside the hazard area for the overall coordination, direction, and safety of the initial full alarm assignment with a minimum of two members dedicated to managing this task.
- (2) Establishment of two uninterrupted water supplies at a minimum of 500 gpm (1892 L/min), with each supply line maintained by an operator.
- (3) Establishment of an effective water flow application rate of 500 gpm (1892 L/min) from three handlines, each of which has a minimum flow rate of 150 gpm (568 L/min), with each handline operated by a minimum of two members to effectively and safely maintain each handline.
- (4) Provision of one support member for each attack, backup, and exposure line deployed to provide hydrant hookup and to assist in laying of hose lines, utility control, and forcible entry.

- (5) Provision of at least two victim search-and-rescue teams, each team consisting of a minimum of two members.
- (6) Provision of at least two teams, each team consisting of a minimum of two members, to raise ground ladders and perform ventilation.
- (7) If an aerial device(s) is used in operations, one member to function as an aerial operator and maintain primary control of the aerial device at all times.
- (8) The establishment of an RIC consisting of an officer and at least three members who are fully equipped and trained in RIC operations.
- (9) The establishment of an initial medical care component consisting of at least two members capable of providing immediate on-scene emergency medical support and transport that provides rapid access to civilians or members potentially needing medical treatment. Where this level of emergency medical care is provided by outside agencies or organizations, these agencies and organizations shall be included in the deployment plan and meet these requirements.

5.2.4.3 Apartment Initial Full Alarm Assignment Capability.

5.2.4.3.1 The initial full alarm assignment to a structure fire in a typical 1200 ft² (111 m²) apartment within a three-story, garden-style apartment building shall provide for the following:

- (1) Establishment of incident command outside the hazard area for the overall coordination, direction, and safety of the initial full alarm assignment with a minimum of two members dedicated to managing this task.
- (2) Establishment of two uninterrupted water supplies at a minimum of 400 gpm (1520 L/min), with each supply line maintained by an operator.
- (3) Establishment of an effective water flow application rate of 300 gpm (1140 L/min) from three handlines, each of which has a minimum flow rate of 100 gpm (380 L/min), with each handline operated by a minimum of two members to effectively and safely maintain each handline.
- (4) Provision of one support member for each attack, backup, and exposure line deployed to provide hydrant hookup and to assist in laying of hose lines, utility control, and forcible entry.
- (5) Provision of at least two victim search-and-rescue teams, each team consisting of a minimum of two members.
- (6) Provision of at least two teams, each team consisting of a minimum of two members, to raise ground ladders and perform ventilation.
- (7) If an aerial device is used in operations, one member to function as an aerial operator and maintain primary control of the aerial device at all times.
- (8) The establishment of an RIC consisting of an officer and at least three members who are fully equipped and trained in RIC operations.
- (9) The establishment of an initial medical care component consisting of at least two members capable of providing immediate on-scene emergency medical support, and transport that provides rapid access to civilian or members potentially needing medical treatment. Where this level of emergency medical care is provided by outside agencies or organizations, those agencies and organizations must be included in the deployment plan and meet these requirements.

5.2.4.4* High-Rise Initial Full Alarm Assignment Capability.

5.2.4.4.1 Initial full alarm assignment to a fire in a building with the highest floor greater than 75 ft (23 m) above the

1710-12 ORGANIZATION AND DEPLOYMENT OF FIRE SUPPRESSION OPERATIONS BY CAREER FIRE DEPARTMENTS

lowest level of fire department vehicle access shall provide for the following:

- (1) Establishment of a stationary incident command post outside the hazard area for overall coordination and direction of the initial full alarm assignment with a minimum of one officer with an aide dedicated to these tasks. All operations shall be conducted in compliance with the incident command system.
- (2) Establishment of an uninterrupted water supply to the building standpipe/sprinkler connection sufficient to support fire attack operations maintained by an operator. If the building is equipped with a fire pump, one additional member with a radio shall also be sent to the fire pump location to monitor and maintain operation.
- (3) Establishment of an effective water flow application rate on the fire floor at a minimum of 500 gpm (1892 L/m) from two handlines, each operated by a minimum of two members to safely and effectively handle the line.
- (4) Establishment of an effective water flow application rate on the floor above the fire floor at a minimum of 250 gpm (946 L/m) from at least one handline, with each handline deployed operated by a minimum of two members to safely and effectively handle the line.
- (5) The establishment of an RIC consisting of four properly equipped and trained members to replace the IRIC two floors below the fire floor (non-IDLH atmosphere) or on the ground floor if the fire is on the second floor or below.
- (6) Provision of two or more search-and-rescue teams consisting of a minimum of two members each.
- (7) Provision of one officer, with an aide dedicated to these tasks, to establish oversight at or near the entry point on the fire floor(s) and on the floor above the fire.
- (8) Provision of two or more evacuation management teams to assist and direct building occupants with evacuation or sheltering actions, with each team consisting of a minimum of two members.
- (9) Provision of one or more members to account for and manage elevator operations.
- (10) Provision of a minimum of one trained incident safety officer.
- (11) Provision of a minimum of one officer two floors below the fire floor to manage the interior staging area.
- (12) Provision of a minimum of two members to manage member rehabilitation. At least one of the members shall be trained to the ALS level.
- (13) Provision of an officer and a minimum of three members to conduct vertical ventilation operations.
- (14) Provision of a minimum of one officer to manage the building lobby operations.
- (15) Provision of a minimum of two members to transport equipment to a location below the fire floor.
- (16) Provision of one officer to manage external base operations.
- (17) Provision of a minimum of two crews trained in emergency medical services with on-scene transport capability, each crew with a minimum of two members. At least one of the members shall be trained to the ALS level.

5.2.4.5 Additional Alarm Assignments.

5.2.4.5.1* Fire departments that respond to fires in occupancies that present hazards greater than those found in the occupancy described in 5.2.4.1 shall deploy additional resources on the initial alarm.

5.2.4.5.2* The fire department shall have the capability to deploy additional alarm assignments that can provide for additional command staff, members, and additional services, including the application of water to the fire; engagement in search and rescue, forcible entry, ventilation, and preservation of property; safety and accountability for personnel; and provision of support activities for those situations that are beyond the capability of the initial full alarm assignment.

5.2.4.5.3 An incident safety officer shall be deployed to all incidents that escalate beyond an initial full alarm assignment or when significant risk is present to members.

5.2.4.5.4 The incident safety officer shall ensure that the safety and health system is established as required in Section 6.1.

5.3* **Emergency Medical Services (EMS).** The purpose of this section shall be to provide standards for the delivery of EMS by fire departments.

5.3.1 The fire department shall clearly document its role, responsibilities, functions, and objectives for the delivery of EMS.

5.3.1.1 EMS operations shall be organized to ensure that the fire department's emergency medical capability includes members, equipment, and resources to deploy the initial arriving company and additional alarm assignments.

5.3.1.2 The fire department shall be permitted to use established automatic aid or mutual aid agreements to comply with the requirements of Section 5.3.

5.3.2* System Components.

5.3.2.1 Treatment Levels.

5.3.2.1.1 The basic treatment levels within an EMS system, for the purposes of this standard, shall be categorized as first responder, basic life support (BLS), and advanced life support (ALS).

5.3.2.1.2 The specific patient treatment capabilities associated with each level shall be determined by the AHJ based on the requirements for approval and licensing of EMS providers within each state or province.

5.3.2.2 Training Levels.

5.3.2.2.1 The minimal level of training for all members that respond to emergency incidents shall be to the first responder/AED level.

5.3.2.2.2 The AHJ shall determine if further training is required.

5.3.3 EMS System Functions.

5.3.3.1 The AHJ shall determine which of the following components of an EMS system the fire department shall be responsible for providing:

- (1) Initial response to provide medical treatment at the location of the emergency (first responder with AED capability or higher)
- (2) BLS response
- (3) ALS response
- (4) Patient transport in an ambulance or alternative vehicle designed to provide for uninterrupted patient care at the ALS or BLS level while en route to a medical facility
- (5) Assurance of response and medical care through a quality management program



5.3.3.2 Staffing.

5.3.3.2.1 On-duty EMS units shall be staffed with the minimum members necessary for emergency medical care relative to the level of EMS provided by the fire department.

5.3.3.2.2 EMS staffing requirements shall be based on the minimum levels needed to provide patient care and member safety.

5.3.3.2.2.1 Units that provide emergency medical care shall be staffed at a minimum with members trained to the first responder/AED level.

5.3.3.2.2.2 Units that provide BLS transport shall be staffed and trained at the level prescribed by the state or provincial agency responsible for providing EMS licensing.

5.3.3.2.2.3 Units that provide ALS transport shall be staffed and trained at the level prescribed by the state or provincial agency responsible for providing EMS licensing.

5.3.3.3 Service Delivery Deployment.

5.3.3.3.1 The fire department shall adopt service delivery objectives based on time standards for the deployment of each service component for which it is responsible.

5.3.3.3.2 Personnel deployed to ALS emergency responses shall include a minimum of two members trained at the emergency medical technician-paramedic level and two members trained at the emergency medical technician-basic level arriving on scene within the established travel time.

5.3.4 Quality Management.

5.3.4.1 The fire department shall institute a quality management program to ensure that the service has met time objectives as required in 4.1.2 for all medical responses.

5.3.4.2 Fire Department Medical Personnel Review.

5.3.4.2.1 All first responder and BLS medical care provided by the fire department shall be reviewed by the fire department medical personnel.

5.3.4.2.2 This review process shall be documented.

5.3.4.3 Medical Director Review.

5.3.4.3.1 All fire departments with ALS services shall have a named medical director with the responsibility to oversee and ensure quality medical care in accordance with state or provincial laws or regulations.

5.3.4.3.2 This review process shall be documented.

5.3.4.4 Fire departments providing ALS services shall provide a mechanism for immediate communications with EMS supervision and medical oversight.

5.4 Special Operations Response. Special operations shall be organized to ensure that the fire department's special operations capability includes members, equipment, and resources to deploy the initial arriving company and additional alarm assignments providing such services.

5.4.1 The fire department shall be permitted to use established automatic aid or mutual aid agreements to comply with the requirements of Section 5.4.

5.4.2 The fire department shall adopt a special operations response plan and SOPs that specify the roles and responsibilities of the fire department and the authorized functions of

members responding to hazardous materials emergency incidents.

5.4.3 All fire department members expected to respond to emergency incidents beyond the first responder operations level for hazardous materials response shall be trained to the applicable requirements of NFPA 472.

5.4.4 All fire department members expected to respond to emergency incidents beyond the confined space operations level for confined space operations shall be trained to the applicable requirements of NFPA 1670.

5.4.5 The fire department shall have the capacity to implement an RIC during all special operations incidents that would subject members to immediate danger or injury in the event of equipment failure or other sudden events, as required by NFPA 1500.

5.4.6 If a higher level of emergency response is needed beyond the capability of the fire department for special operations, the fire department shall determine the availability of outside resources that deploy these capabilities and the procedures for initiating their response.

5.4.7 The fire department shall limit its activities to only those specific special operations functions for which its members have been trained and are correctly equipped.

5.5 Airport Rescue and Fire-Fighting (ARFF) Services.

5.5.1 Airport fire departments shall adopt operations response plans and SOPs that specify the roles and responsibilities for nonaircraft incidents as required by 5.1.2.

5.5.2 ARFF operations shall be organized to ensure that the fire department's capability includes members, equipment, and resources to deploy the initial arriving company, the initial full alarm assignment, and additional alarm assignments as required in 5.2.4.

5.5.3 Airport fire departments shall have access to special tools, equipment, supplies, personal protective equipment (PPE), and other airport resources that are required to perform operations in their assigned roles and responsibilities.

5.5.4 Deployment.

5.5.4.1 The airport fire department shall deploy the required number of ARFF vehicles required for the airport's assigned category as established by NFPA 403.

5.5.4.2 Airport fire department companies equipped with specialized apparatus and equipment shall be provided to assist ARFF companies where deemed necessary as identified in 5.5.1.

5.5.4.3 Airport fire department companies that deploy to structure fire incidents on airport property shall meet the time objective requirements of 4.1.2.

5.5.4.4 Airport fire department companies that deploy to emergency medical incidents on airport property shall meet the time objective requirements of 4.1.2.

5.5.4.5 The airport fire department shall be permitted to use established automatic aid or mutual aid agreements to comply with the requirements of Section 5.5.

5.5.5 Staffing.

5.5.5.1 Airport fire department ARFF companies shall be staffed as required by NFPA 403.

1710-14 ORGANIZATION AND DEPLOYMENT OF FIRE SUPPRESSION OPERATIONS BY CAREER FIRE DEPARTMENTS

5.5.5.2 Airport fire department companies that deploy to structure fire incidents on airport property shall meet the staffing requirements of 5.2.2.

5.5.5.3 Airport fire department companies that deploy to emergency medical incidents on airport property shall meet the staffing requirements of 5.3.3.2.

5.5.6 Emergency Operations.

5.5.6.1 At all emergency scene operations, an incident management system shall be used that meets the requirements of Section 6.2.

5.5.6.2* Incident command shall be established outside of the hazard area for the overall coordination and direction of the initial full alarm assignment.

5.5.6.3 A member shall be dedicated to the task of incident commander.

5.5.6.4 Incident Safety Officer.

5.5.6.4.1 An incident safety officer shall be deployed to all incidents that escalate beyond a full alarm assignment or when members face significant risk.

5.5.6.4.2 The incident safety officer shall ensure that the safety and health system is established as required in Section 6.1.

5.6* Marine Rescue and Fire-Fighting (MRFF) Services.

5.6.1 MRFF operations shall be organized to ensure that the fire department's marine capability includes members, equipment, and resources to deploy to the alarm assignments associated with a marine emergency incident.

5.6.2 Response Plan.

5.6.2.1 The fire department shall adopt a marine operations response plan and SOPs that specify the roles and responsibilities of the fire department and the authorized functions of members responding to marine emergencies.

5.6.2.2 Fire department marine operations response plans and SOPs shall be coordinated with the applicable agencies, such as the port or harbor authority and supporting agencies.

5.6.3 Marine fire departments shall have access to special tools, equipment, supplies, PPE, and other marine resources that are required to perform operations in their assigned roles and responsibilities.

5.6.4 Staffing.

5.6.4.1 Numbers of On-Duty Marine Personnel.

5.6.4.1.1 On-duty marine personnel shall consist of the number necessary for fire-fighting performance relative to the expected MRFF conditions.

5.6.4.1.2 On-duty marine members numbers shall be determined through task analyses as required for types of marine vessels and through additional task analyses that take the following factors into consideration:

- (1) Life hazard to the populace protected
- (2) Provisions of safe and effective fire-fighting performance conditions for the members
- (3) Potential property loss
- (4) Nature, configuration, hazards, and internal protection of the properties involved

(5) Types of tactics and evolutions employed as standard procedure, type of marine vessel used, and results expected to be obtained at the fire scene

(6) Requirements of the regulatory AHJs over navigable waters, ports, and harbors

5.6.4.2 Organization of On-Duty Members.

5.6.4.2.1 On-duty members assigned to marine fire fighting shall be organized into company units and shall have required vessels and equipment assigned to such companies.

5.6.4.2.2 Each marine company shall be led by an officer who shall be considered a part of the company.

5.6.5 Operating Units.

5.6.5.1* Fire companies whose primary function is to deliver and pump water and extinguishing agents at the scene of a marine incident shall be known as marine companies.

5.6.5.2 These companies shall be staffed with a minimum number of on-duty members as required by the tactical and occupancy hazards to which the marine vessel responds and by the regulatory AHJs over navigable waters, ports, and harbors.

5.7 Wildland Fire Suppression Services.

5.7.1 Wildland fire suppression operations shall be organized to ensure that the fire department's wildland fire suppression capability includes members, equipment, and resources to deploy wildland direct operations that can address marginal situations before they get out of control and wildland indirect fire-fighting operations that can be assembled and placed into operation against major wildland fires.

5.7.2 Organization.

5.7.2.1 Fire departments performing wildland operations shall adopt a wildland fire-fighting operations response plan and SOPs that specify the roles and responsibilities of the fire department and the authorized functions of members responding to wildland fire emergencies.

5.7.2.2 All wildland fire suppression operations shall be organized to ensure compliance with NFPA 1143.

5.7.3 Fire departments performing wildland operations shall have access to special tools, equipment, supplies, PPE, and other wildland resources that are required to perform operations in their assigned roles and responsibilities.

5.7.4 Staffing. The number of on-duty wildland fire-fighting personnel shall be sufficient to perform the necessary fire-fighting operations given the expected wildland fire-fighting conditions.

5.7.4.1 On-duty wildland fire-fighting members numbers shall be determined through task analyses that take the following factors into consideration:

- (1) Life hazard to the populace protected
- (2) Provisions of safe and effective fire-fighting performance conditions for the members
- (3) The number of trained response members available to the department, including mutual aid resources
- (4) Potential property loss
- (5) Nature, configuration, hazards, and internal protection of the properties involved



- (6) Types of wildland tactics and evolutions employed as standard procedure, type of apparatus used, and results expected to be obtained at the fire scene
- (7) Topography, vegetation, and terrain in the response area(s)

5.7.4.2 On-duty personnel assigned to wildland operations shall be organized into company units and shall have required apparatus and equipment assigned to such companies.

5.7.4.2.1 The fire department shall identify minimum company staffing levels necessary to meet the deployment criteria to ensure that a sufficient number of members are assigned, on duty, and available to respond with each company.

5.7.4.2.2 Each company shall be led by an officer who shall be considered a part of the company.

5.7.4.2.3 Supervisory chief officers shall be dispatched or notified to respond to all full alarm assignments.

5.7.4.2.4 The supervisory chief officer shall ensure that the incident management system is established as required in Section 6.2.

5.7.5 Operating Units. Fire companies whose primary function is to deliver and pump water and extinguishing agents at the scene of a wildland fire shall be known as wildland companies.

5.7.5.1 These companies shall be staffed with a minimum of four on-duty members.

5.7.5.2 Engine and ladder (truck) companies that respond to wildland fire fighting and/or urban interface wildland fire fighting incidents shall be staffed as required by 5.2.3.

5.7.5.3 Other Types of Companies.

5.7.5.3.1 Other types of companies equipped with specialized apparatus and equipment for wildland fire fighting, including aircraft, heavy equipment, mini pumpers, and fast attack vehicles, shall be provided to assist wildland engine and ladder companies where deemed necessary as part of established practice.

5.7.5.3.2 These companies shall be staffed with a minimum number of on-duty personnel as required by the tactical, topographical, environmental, fuel (vegetation), and occupancy hazards.

5.7.6 Deployment.

5.7.6.1 Required Number of Vehicles.

5.7.6.1.1 The fire department shall deploy from its wildland resources the number of vehicles required for a direct and/or indirect attack.

5.7.6.1.2* Prior to the initiation of any wildland fire attack, the fire department shall have the capacity to establish a lookout(s), communications with all crew members, escape route(s), and safety zone(s) for vehicles and members.

5.7.6.2 Direct Attack.

5.7.6.2.1 The fire department shall have the capability to initiate a direct wildland attack within 10 minutes after arrival of the initial company or crew at the fire scene.

5.7.6.2.2 One member in the first arriving company or crew shall be assigned as the incident commander for the overall coordination and direction of the direct attack activities.

5.7.6.2.3 The direct wildland attack shall include the establishment of an effective water flow application rate of 30 gpm (114 L/min) from at least two 500 ft (150 m) 1½ in. (38 mm) diameter attack handlines from two engines.

5.7.6.2.4 Each attack handline shall be operated by a minimum of two members to deploy and maintain the line.

5.7.6.2.5 One operator shall remain with each fire apparatus supplying water flow to ensure uninterrupted water flow application.

5.7.6.2.6 A wildland crew leader or company officer shall be provided with each crew to be responsible for overall supervision of each of the crew and for maintaining personnel accountability and crew safety.

5.7.6.3 Indirect Attack.

5.7.6.3.1 The fire department providing wildland fire suppression operations shall have the capability to deploy an indirect attack, including application of water to the fire, engagement in search and rescue and preservation of property, accountability for personnel, and provision of support activities for those situations that are beyond the capability of the direct attack.

5.7.6.3.2 An incident safety officer shall be deployed to all incidents that escalate beyond a direct attack alarm assignment or when members face significant risk.

5.7.7 Non-Wildland Emergencies.

5.7.7.1 Wildland companies that deploy to structure fire incidents shall meet the time objective requirements of 4.1.2.

5.7.7.2 Wildland companies that deploy to emergency medical incidents shall meet the time objective requirements of 4.1.2.

Chapter 6 Systems

6.1 Safety and Health System. A fire-fighter occupational safety and health program shall be provided in accordance with NFPA 1500.

6.2* Incident Management System.

6.2.1 An incident management system shall be provided in accordance with NFPA 1561 to form the basic structure of all emergency operations of the fire department, regardless of the scale of the department or the emergency.

6.2.2* An incident management system shall be designed to manage incidents of different types, including structure fires, wildland fires, hazardous materials incidents, emergency medical operations, and other types of emergencies that could be encountered by the department.

6.3 Training Systems.

6.3.1 The fire department shall have a training program and policy that ensure that members are trained and competency is maintained to execute all responsibilities consistent with the department's organization and deployment as addressed in Chapters 4 and 5.

6.3.2 The agency must demonstrate in its annual report that it has ensured competency for necessary knowledge, skills, and abilities based on the community's specific hazards and risks, to include at least the hazards specifically addressed in

this standard, for each member that is considered part of the effective response force.

6.3.3 The agency must adopt training standards based on the sited hazards and risk, set appropriate objectives to achieve the standards, and demonstrate that it is meeting the objectives as part of demonstrating training and competency.

6.4 Communications Systems.

6.4.1 The fire department shall have a reliable communications system to facilitate prompt delivery of public fire suppression, EMS, and special operations.

6.4.2 All communications facilities, equipment, staffing, operating procedures, performance objectives, and reporting shall comply with NFPA 1221.

6.4.3 Operating procedures for radio communications shall provide for the use of standard protocols and terminology at all types of incidents.

6.4.4 Standard terminology, in compliance with NFPA 1561, shall be established to transmit information, including strategic modes of operation, situation reports, and emergency notifications of imminent hazards.

6.5* Pre-Incident Planning.

6.5.1 The fire department shall set forth operational requirements to conduct pre-incident planning.

6.5.2 Particular attention shall be provided to all target hazards.

Annex A Explanatory Material

Annex A is not a part of the requirements of this NFPA document but is included for informational purposes only. This annex contains explanatory material, numbered to correspond with the applicable text paragraphs.

A.1.1 The standard includes minimum requirements that are intended to provide effective, efficient, and safe protective services that operate on a sound basis to prevent fires, reduce risk to lives and property, deal with incidents that occur, and prepare for anticipated incidents. It sets minimum standards considered necessary for the provision of public fire protection by career fire departments. It addresses the structure and operation of organizations providing such services, including fire suppression and other assigned emergency response responsibilities, which include EMS and special operations.

A.1.2.1 A fundamental concept of fire risk is associated with modern society. Public fire service organizations are expected to reduce the risk within their areas of jurisdiction by taking measures to prevent the outbreak of fires, limit the extent and severity of fires, provide for the removal or rescue of endangered persons, control and extinguish fires that occur within the jurisdiction, and perform other emergency response operations and delivery of EMS.

The cumulative effects of preventive efforts, risk reduction and control, and fire suppression capabilities result in variable levels of risk to the jurisdictions and their residents.

The risk remaining after deducting the cumulative effect of the public fire service organization's efforts is the responsibility of each individual, including owners, operators, occupants, and casual visitors to properties. It should be noted that fire risk cannot be completely avoided or eliminated.

A.1.4 Nothing in this standard is intended to prohibit the use of systems, methods, or approaches of equivalent or superior performance to those prescribed by this standard. The equivalency statement contained in this standard allows jurisdictions to use other "systems, methods, or approaches" to meet requirements of the standard if they can validate and document in writing that such are equal or superior to the requirements contained in the standard. This equivalency statement is not intended to allow any jurisdiction or fire department to reduce the requirements in the standard and still claim compliance. Moreover, it specifically requires any jurisdiction relying on "equivalent" systems, methods, or approaches to validate, demonstrate, and document in writing that the standard is equal or superior to the requirements contained in this standard.

The authority having jurisdiction (AHJ) determines what systems, methods, or approaches are equivalent or superior in performance. The AHJ should approach the assessment by reviewing the overall public fire protection and EMS system performance.

A.3.2.1 Approved. The National Fire Protection Association does not approve, inspect, or certify any installations, procedures, equipment, or materials; nor does it approve or evaluate testing laboratories. In determining the acceptability of installations, procedures, equipment, or materials, the authority having jurisdiction may base acceptance on compliance with NFPA or other appropriate standards. In the absence of such standards, said authority may require evidence of proper installation, procedure, or use. The authority having jurisdiction may also refer to the listings or labeling practices of an organization that is concerned with product evaluations and is thus in a position to determine compliance with appropriate standards for the current production of listed items.

A.3.2.2 Authority Having Jurisdiction (AHJ). The phrase "authority having jurisdiction," or its acronym AHJ, is used in NFPA documents in a broad manner, since jurisdictions and approval agencies vary, as do their responsibilities. Where public safety is primary, the authority having jurisdiction may be a federal, state, local, or other regional department or individual such as a fire chief; fire marshal; chief of a fire prevention bureau, labor department, or health department; building official; electrical inspector; or others having statutory authority. For insurance purposes, an insurance inspection department, rating bureau, or other insurance company representative may be the authority having jurisdiction. In many circumstances, the property owner or his or her designated agent assumes the role of the authority having jurisdiction; at government installations, the commanding officer or departmental official may be the authority having jurisdiction.

A.3.3.2.1 Automatic Aid. Automatic aid is established through a written intergovernmental agreement that provides for the simultaneous dispatch of a predetermined response of personnel and equipment to a neighboring jurisdiction upon receipt of an alarm and is included as part of a communication center's dispatch protocols.

A.3.3.4 Aircraft Rescue and Fire-Fighting (ARFF) Vehicle. The apparatus is typically equipped with a large water tank [commencing at 1000 gal (3800 L) and extending to over 6000 gal (22,800 L)]; a supply of fire-fighting extinguishing agents; remote-controlled large roof turret(s), extendable turret nozzle(s), and bumper turret(s) (ground sweep nozzles) that are used for the discharge of extinguishing agent; and pre-connected handlines.

A.3.3.5 Alarm. In some jurisdictions, an alarm is referred to as an incident or call for service.

A.3.3.13 Company. For fire suppression and other emergency operations, in some jurisdictions, the response capability of the initial arriving company is configured with two apparatus operating together. This can be a result of apparatus not being configured with seated and belted positions for four members, therefore requiring a second vehicle to carry additional personnel. It can also be the result of the fire department's SOPs, which require two apparatus operating together to complete the operational procedures. The objective is to ensure that a minimum of four personnel are assigned to and deployed as a company. The two (or more) pieces of apparatus would always be dispatched and respond together as a single company. Some examples of this include the following:

- (1) A pumper and tanker/tender that would be responding together outside a municipal water district
- (2) A multiple-piece company, specified as such in a fire department's SOPs, such as an engine or ladder company that responds with a rescue unit, water tender, or other type of apparatus
- (3) A company that consists of a pumper with an additional vehicle as a personnel carrier
- (4) A pumper and an ambulance or rescue unit that always respond together

A.3.3.21.1 Aircraft Rescue and Fire Fighting. Such rescue and fire-fighting actions are performed both inside and outside of the aircraft.

A.3.3.21.2 Marine Rescue and Fire Fighting. Marine companies can be utilized for special operations, including a platform for dive and scuba operations and for providing a secure water supply for land-based operations.

A.3.3.23 Fire Suppression. Fire suppression includes all activities performed at the scene of a fire incident or training exercise that expose fire department members to the dangers of heat, flame, smoke, and other products of combustion, explosion, or structural collapse. [1500, 2013]

A.3.3.24 First Responder (EMS). A first responder also assists higher level EMS providers.

A.3.3.26 Hazard. Hazards include the characteristics of facilities, equipment systems, property, hardware, or other objects; and the actions and inactions of people that create such hazards.

A.3.3.28 High-Hazard Occupancy. These occupancies include schools, hospitals, and other special medical facilities, nursing homes, high-risk residential occupancies, neighborhoods with structures in close proximity to one another, high-rise buildings, explosives plants, refineries, and hazardous materials occupancies.

A.3.3.30 Incident Management System (IMS). The system should be consistent with NIMS and the National Response Framework. The system is also referred to as an incident command system (ICS).

A.3.3.36.2 Basic Life Support (BLS). Basic life support could also include expediting the safe and timely transport of the patient to a hospital emergency department for definitive medical care.

A.3.3.38 Member. A fire department member can be a full-time or part-time employee or a paid or unpaid volunteer, can

occupy any position or rank within the fire department, and can engage in emergency operations. [1500, 2013]

A.3.3.40.1 Company Officer. This person can be someone appointed in an acting capacity. The rank structure could be either sergeant, lieutenant, or captain.

A.3.3.40.3 Supervisory Chief Officer. The position of supervisory chief officer is above that of a company officer, who responds automatically and/or is dispatched to an alarm beyond the initial alarm capabilities, or other special calls. In some jurisdictions, this is the rank of battalion chief, district chief, deputy chief, assistant chief, or senior divisional officer (U.K. fire service).

A.3.3.41.2 Special Operations. Special operations include water rescue, extrication, hazardous materials, confined space entry, high-angle rescue, aircraft rescue and fire fighting, and other operations requiring specialized training. [1500, 2013]

A.3.3.44 Rapid Intervention Crew (RIC). The RIC reports directly to the incident commander or operations chief. This dedicated crew is not to be confused with the IRIC.

A.3.3.48 Staff Aide. This member is assigned to a supervisory chief officer who assists at incident scene operations, which can include personnel accountability, communications, and other logistical and administrative support. In addition, this member can assist in coordinating training activities, respond to citizen inquiries, coordinate staffing issues and sick leave follow-up, and assign resource allocations for facilities and apparatus under the supervisory chief officer's jurisdiction. Staff aides can be known as field incident technician, staff assistant, battalion fire fighter, or battalion adjutant.

A.3.3.53.5 Initiating Action/Intervention Time. A benchmark time frame isn't set to initiate a mitigating action or take other steps to intervene in resolving the issue that created the incident. Fire departments should track these times based on their SOPs and evaluate the data based on the nature of the incident.

A.3.3.53.6 Total Response Time. A "cascade of events" chart, shown as Figure A.3.3.53.6, is provided to assist understanding the relationship between NFPA 1221, NFPA 1710, and Initiating Time/Intervention Time (currently not addressed by a single NFPA standard). Three phases are included in total response time. They are as follows:

- (1) Phase One — Alarm Handling Time, which includes alarm transfer time, alarm answering time, and alarm processing time (addressed by NFPA 1221)
- (2) Phase Two — Turnout Time and Travel Time (addressed by NFPA 1710)
- (3) Phase Three — Initiating Action/Intervention Time

A.4.1.1 The AHJ generally has the responsibility to determine the following:

- (1) Scope and level of service provided by the fire department
- (2) Necessary level of funding
- (3) Necessary level of personnel and resources, including facilities

To provide service, the AHJ should have the power to levy taxes or solicit funding, to own property and equipment, and to cover personnel costs. The authority necessary is conveyed by law to a local jurisdiction.

In addition, the governing body also should monitor the achievement of the management goals of the department,

A.3.3.5 Alarm. In some jurisdictions, an alarm is referred to as an incident or call for service.

A.3.3.13 Company. For fire suppression and other emergency operations, in some jurisdictions, the response capability of the initial arriving company is configured with two apparatus operating together. This can be a result of apparatus not being configured with seated and belted positions for four members, therefore requiring a second vehicle to carry additional personnel. It can also be the result of the fire department's SOPs, which require two apparatus operating together to complete the operational procedures. The objective is to ensure that a minimum of four personnel are assigned to and deployed as a company. The two (or more) pieces of apparatus would always be dispatched and respond together as a single company. Some examples of this include the following:

- (1) A pumper and tanker/tender that would be responding together outside a municipal water district
- (2) A multiple-piece company, specified as such in a fire department's SOPs, such as an engine or ladder company that responds with a rescue unit, water tender, or other type of apparatus
- (3) A company that consists of a pumper with an additional vehicle as a personnel carrier
- (4) A pumper and an ambulance or rescue unit that always respond together

A.3.3.21.1 Aircraft Rescue and Fire Fighting. Such rescue and fire-fighting actions are performed both inside and outside of the aircraft.

A.3.3.21.2 Marine Rescue and Fire Fighting. Marine companies can be utilized for special operations, including a platform for dive and scuba operations and for providing a secure water supply for land-based operations.

A.3.3.23 Fire Suppression. Fire suppression includes all activities performed at the scene of a fire incident or training exercise that expose fire department members to the dangers of heat, flame, smoke, and other products of combustion, explosion, or structural collapse. [1500, 2013]

A.3.3.24 First Responder (EMS). A first responder also assists higher level EMS providers.

A.3.3.26 Hazard. Hazards include the characteristics of facilities, equipment systems, property, hardware, or other objects; and the actions and inactions of people that create such hazards.

A.3.3.28 High-Hazard Occupancy. These occupancies include schools, hospitals, and other special medical facilities, nursing homes, high-risk residential occupancies, neighborhoods with structures in close proximity to one another, high-rise buildings, explosives plants, refineries, and hazardous materials occupancies.

A.3.3.30 Incident Management System (IMS). The system should be consistent with NIMS and the National Response Framework. The system is also referred to as an incident command system (ICS).

A.3.3.36.2 Basic Life Support (BLS). Basic life support could also include expediting the safe and timely transport of the patient to a hospital emergency department for definitive medical care.

A.3.3.38 Member. A fire department member can be a full-time or part-time employee or a paid or unpaid volunteer, can

occupy any position or rank within the fire department, and can engage in emergency operations. [1500, 2013]

A.3.3.40.1 Company Officer. This person can be someone appointed in an acting capacity. The rank structure could be either sergeant, lieutenant, or captain.

A.3.3.40.3 Supervisory Chief Officer. The position of supervisory chief officer is above that of a company officer, who responds automatically and/or is dispatched to an alarm beyond the initial alarm capabilities, or other special calls. In some jurisdictions, this is the rank of battalion chief, district chief, deputy chief, assistant chief, or senior divisional officer (U.K. fire service).

A.3.3.41.2 Special Operations. Special operations include water rescue, extrication, hazardous materials, confined space entry, high-angle rescue, aircraft rescue and fire fighting, and other operations requiring specialized training. [1500, 2013]

A.3.3.44 Rapid Intervention Crew (RIC). The RIC reports directly to the incident commander or operations chief. This dedicated crew is not to be confused with the IRIC.

A.3.3.48 Staff Aide. This member is assigned to a supervisory chief officer who assists at incident scene operations, which can include personnel accountability, communications, and other logistical and administrative support. In addition, this member can assist in coordinating training activities, respond to citizen inquiries, coordinate staffing issues and sick leave follow-up, and assign resource allocations for facilities and apparatus under the supervisory chief officer's jurisdiction. Staff aides can be known as field incident technician, staff assistant, battalion fire fighter, or battalion adjutant.

A.3.3.53.5 Initiating Action/Intervention Time. A benchmark time frame isn't set to initiate a mitigating action or take other steps to intervene in resolving the issue that created the incident. Fire departments should track these times based on their SOPs and evaluate the data based on the nature of the incident.

A.3.3.53.6 Total Response Time. A "cascade of events" chart, shown as Figure A.3.3.53.6, is provided to assist understanding the relationship between NFPA 1221, NFPA 1710, and Initiating Time/Intervention Time (currently not addressed by a single NFPA standard). Three phases are included in total response time. They are as follows:

- (1) Phase One — Alarm Handling Time, which includes alarm transfer time, alarm answering time, and alarm processing time (addressed by NFPA 1221)
- (2) Phase Two — Turnout Time and Travel Time (addressed by NFPA 1710)
- (3) Phase Three — Initiating Action/Intervention Time

A.4.1.1 The AHJ generally has the responsibility to determine the following:

- (1) Scope and level of service provided by the fire department
- (2) Necessary level of funding
- (3) Necessary level of personnel and resources, including facilities

To provide service, the AHJ should have the power to levy taxes or solicit funding, to own property and equipment, and to cover personnel costs. The authority necessary is conveyed by law to a local jurisdiction.

In addition, the governing body also should monitor the achievement of the management goals of the department,

1710-18 ORGANIZATION AND DEPLOYMENT OF FIRE SUPPRESSION OPERATIONS BY CAREER FIRE DEPARTMENTS

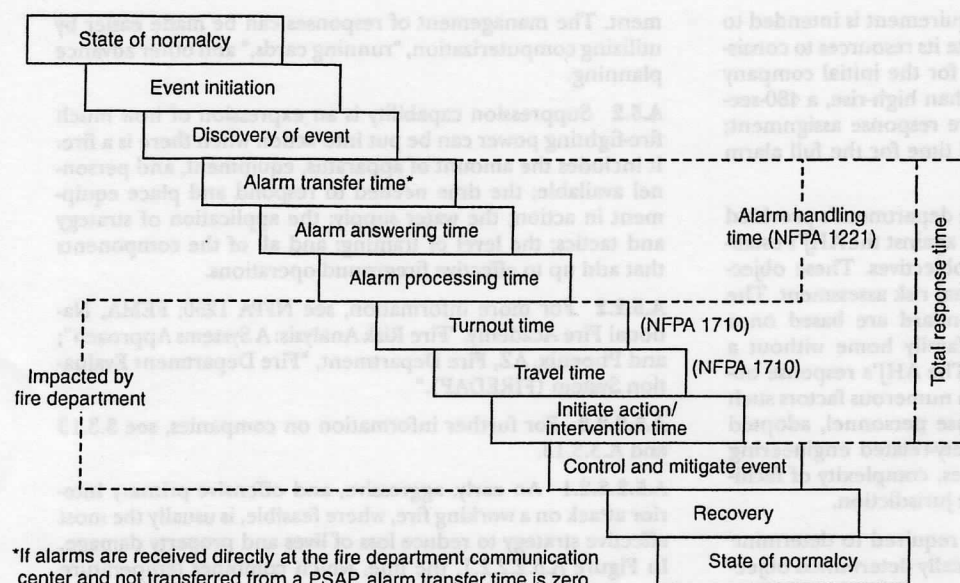


FIGURE A.3.3.53.6 Cascade of Events Chart.

such as fire prevention, community life safety education, fire suppression, employee training, communications, maintenance, and department administration.

The organizational statement is a very important basis for many of the provisions of this standard. The statement sets forth the legal basis for operating a fire department, the organizational structure of the fire department, number of members, training requirements, expected functions, and authorities and responsibilities of various members or defined positions.

A key point is to clearly set out the specific services the fire department is authorized and expected to perform. Most fire departments are responsible to a governing body. The governing body has the right and should assert its authority to set the specific services and the limits of the services the fire department will provide. It also has the responsibility to furnish the necessary resources for delivery of the designated services. The fire department should provide its governing body with a specific description of each service, with options or alternatives and an accurate analysis of the costs and resources needed for each service.

Such services could include structural fire fighting, wild-land fire fighting, airport/aircraft fire fighting, emergency medical services, hazardous materials response, high-angle rescue, heavy rescue, and others.

Spelling out the specific parameters of services to be provided allows the fire department to plan, staff, equip, train, and deploy members to perform these duties. It also gives the governing body an accounting of the costs of services and allows it to select those services it can afford to provide. Likewise, the governing body should identify services it cannot afford to provide and cannot authorize the fire department to deliver, or it should assign those services to another agency.

The factors that should be included in the AHJ's risk assessment process include adopted building codes, required fire/life safety related engineering controls, accepted service delivery performance objectives, complexity of facilities, and

occupancy hazards (low, medium, and high) within the jurisdiction.

The fire department should be no different than any other government agency that has the parameters of its authority and services clearly defined by the governing body.

Legal counsel should be used to ensure that any statutory services and responsibilities are being met.

The majority of public fire departments are established under the charter provisions of their governing body or through the adoption of statutes. These acts define the legal basis for operating a fire department, the mission of the organization, the duties that are authorized and expected to be performed, and the authority and responsibilities that are assigned to certain members to direct the operations of the fire department.

The documents that officially establish the fire department as an identifiable organization are necessary to determine specific responsibilities and to determine the parties responsible for compliance with the provisions of this standard.

In many cases, these documents can be part of state laws, a municipal charter, or an annual budget. In such cases, it would be appropriate to make these existing documents part of the organizational statement, if applicable.

A.4.1.2 There can be incidents or areas where the response criteria are affected by circumstances such as response personnel who are not on duty, unstaffed fire station facilities, natural barriers, traffic congestion, insufficient water supply, and density of population or property. The reduced level of service should be documented in the written organizational statement by the percentage of incidents and geographical areas for which the total response time criteria are achieved.

Additional service delivery performance objectives should be established by the AHJ for occupancies other than those identified within the standard for benchmark single-family dwellings. Factors to be considered include specific response areas (i.e., suburban, rural, and wilderness) and occupancy hazards.

A.4.1.2.1(3) This service delivery requirement is intended to have a fire department plan and situate its resources to consistently meet a 240-second travel time for the initial company fire suppression response; for other than high-rise, a 480-second travel time for the full alarm fire response assignment; and for high-rise, a 610-second travel time for the full alarm fire response assignment.

A.4.1.2.5.1 The evaluation of the fire department's provided level of service needs to be performed against the AHJ's established service delivery performance objectives. These objectives should be based on a jurisdictional risk assessment. The objectives established within this standard are based on a 2000 ft² (186 m²), two-story, single-family home without a basement and having no exposures. The AHJ's response objectives should be established based on numerous factors such as the circumstances affecting response personnel, adopted building codes, required fire/life safety-related engineering controls, accepted turnout/travel times, complexity of facilities, and occupancy hazards within the jurisdiction.

A.4.1.2.5.2 The collection of data is required to determine the organization's ability to meet its locally determined objectives and the performance objectives contained in the standard with regard to emergency incidences (warning lights and sirens). Organizations respond to numerous types of emergency and nonemergency incidents. While the collection and analysis of all of the response data is important, attainment of the 90 percent objective is only to be evaluated against emergency incident responses.

A.4.4.2 Occupational Safety and Health Administration (OSHA) regulations require that all fire departments be trained to respond to hazardous materials incidents at the first responder operations level.

Title III of the Superfund Amendments and Reauthorization Act of 1986 (SARA), known as the Emergency Planning and Community Right-to-Know Act, established requirements for federal, state, and local governments and industrial facilities regarding emergency planning for spills or other releases, community right-to-know, and reporting of hazardous and toxic chemicals.

The Emergency Planning and Community Right-to-Know Act covers the following four major areas that provide the fire service and communities with a broad perspective on the chemical hazards within the local area and those at individual facilities:

- (1) Sections 301 through 303 — emergency planning
- (2) Section 304 — emergency release notification
- (3) Sections 311 and 312 — community right-to-know reporting requirements
- (4) Section 313 — toxic chemical release inventory

A.4.8.1 Where appropriate, the mutual aid agreement should include automatic responses on first alarms (automatic aid). This concept contemplates joint response of designated apparatus and personnel on a predetermined running assignment basis.

Mutual aid concepts should be considered on a regional basis. In an effective mutual aid arrangement, each fire department should retain reserves of personnel and apparatus. Traditionally and legally, overall command of the incident is vested with the senior officer of the jurisdiction experiencing the emergency.

Some areas use consolidated dispatching to coordinate the response of fire companies to assist an outside fire department.

The management of responses can be made easier by utilizing computerization, "running cards," and other advance planning.

A.5.2 Suppression capability is an expression of how much fire-fighting power can be put into action when there is a fire. It includes the amount of apparatus, equipment, and personnel available; the time needed to respond and place equipment in action; the water supply; the application of strategy and tactics; the level of training; and all of the components that add up to effective fireground operations.

A.5.2.2 For more information, see NFPA 1250; FEMA, National Fire Academy, "Fire Risk Analysis: A Systems Approach"; and Phoenix, AZ, Fire Department, "Fire Department Evaluation System (FIRECAP)."

A.5.2.2.2 For further information on companies, see 3.3.13 and A.3.3.13.

A.5.2.2.2.1 An early, aggressive, and offensive primary interior attack on a working fire, where feasible, is usually the most effective strategy to reduce loss of lives and property damage. In Figure A.5.2.2.2.1, the line, which combines temperature rise and time, represents a rate of fire propagation in an unsprinklered room and roughly corresponds to the percentage of property destruction. At approximately 10 minutes into the fire sequence, the hypothetical room of origin flashes over. Extension outside the room begins at that point.

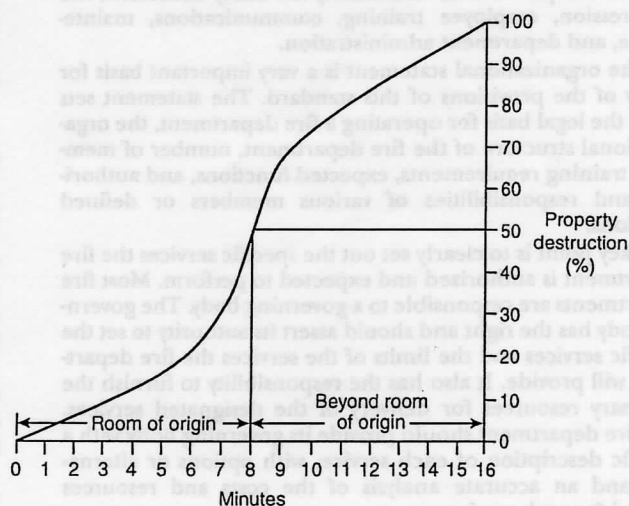


FIGURE A.5.2.2.2.1 Fire Propagation Curve.

Consequently, given that the progression of a structure fire to the point of flashover (i.e., the very rapid spreading of the fire due to superheating of room contents and other combustibles) generally occurs in less than 10 minutes, two of the most important elements in limiting fire spread are the quick arrival of sufficient personnel and equipment to attack and extinguish the fire as close to the point of its origin as possible. For more information, refer to *Fire Service Today*, "Reduced Staffing: At What Cost," and NIST, "Hazard I Fire Hazard Assessment Method." Also, refer to National Fire Academy, "Fire Risk Analysis: A Systems Approach," and Office of the Ontario Fire Marshal, *Shaping the Future of Fire Ground Staffing and Delivery Systems Within a Comprehensive Fire Safety Effectiveness Model*.

1710-20 ORGANIZATION AND DEPLOYMENT OF FIRE SUPPRESSION OPERATIONS BY CAREER FIRE DEPARTMENTS

The ability of adequate fire suppression forces to significantly influence the outcome of a structure fire is undeniable and predictable. Data generated by NFPA and used by the committee in developing this standard provide empirical data that rapid and aggressive interior attack can substantially reduce the human and property losses associated with structure fires [see Table A.5.2.2.2.1(a) and Table A.5.2.2.2.1(b)].

The NFPA Fire Analysis and Research Division provided the data in Table A.5.2.2.2.1(b) as an update of Table A.5.2.2.2.1(a).

Table A.5.2.2.2.1(a) Fire Extension in Residential Structures, 1994–1998

Extension	Rate per 1000 Fires		
	Civilian Deaths	Civilian Injuries	Average Dollar Loss per Fire
Confined to room of origin	2.32	35.19	\$3,185
Beyond the room but confined to floor of origin	19.68	96.86	\$22,720
Beyond floor of origin	26.54	63.48	\$31,912

Note: Residential structures include dwellings, duplexes, manufactured homes (also called mobile homes), apartments, row houses, townhouses, hotels and motels, dormitories, and barracks.

Source: NFPA Annual Fire Experience Survey and National Fire Incident Reporting System (NFIRS).

A.5.2.2.2.3 The assignment of specific response districts to command officers should be based on the number of companies, workload, and response distances. Department administrative procedures should indicate clearly the jurisdiction of command officers.

A.5.2.2.2.5 For further information on staff aides, see 3.3.48 and A.3.3.48.

A.5.2.4.1.1 The hazards presented by this scenario are not unusual, as all communities respond to fire incidents in this type of structure on a regular basis.

A.5.2.4.2.1 The open-air strip shopping center represents more than 67 percent of types of shopping centers, as described by the International Council of Shopping Centers (ICSC). The ICSC describes these centers as “usually configured in a straight line as a strip, or may be laid out in an L or U shape, depending on the site and design. They consist of an attached row of stores or service outlets managed as a coherent retail entity, with on-site parking usually located in front of the stores. Open canopies may connect the store fronts, but a strip center does not have enclosed walkways linking the stores. The open air strip shopping center may contain between five and 40 stores of varying occupancy types and hazards with three or more being larger, anchor stores such as a discount store, supermarket, drug, or large specialty discount store.”

A.5.2.4.4 See “Report on High-Rise Fireground Field Experiments,” NIST, April 2013, for more information.

A.5.2.4.5.1 Other occupancies and structures in the community that present greater hazards should be addressed by addi-

Table A.5.2.2.2.1(b) Fire Extension Home Structure Fires, 2006–2010 Rate per 1000 Fires

Flame Spread	Rate per 1000 Fires		
	Civilian Deaths	Civilian Injuries	Average Dollar Loss per Fire
Confined fires or contained fire identified by incident type*	0.000	10.29	\$212
Confined fire or flame damage confined to object of origin	0.65	13.53	\$1,565
Confined to room of origin, including confined fires and fires confined to object	1.91	25.32	\$2,993
Beyond the room but confined to floor of origin	22.73	64.13	\$7,445
Beyond floor of origin	24.63	60.41	\$58,431

* NFIRS 5.0 has six categories of confined structure fires: cooking fires confined to the cooking vessel, confined chimney or flue fires, confined incinerator fires, confined fuel burner or boiler fires or delayed ignitions, confined commercial compactor fires, and trash or rubbish fires in a structure with no flame damage to the structure or its contents.

Note: Homes include one- and two-family homes (including manufactured housing) and apartments or other multifamily housing. These statistics are national estimates based on fires reported to U.S. municipal fire departments and so exclude fires reported only to federal or state agencies. National estimates are projections. Casualty and loss projections can be heavily influenced by the inclusion or exclusion of one unusually serious fire. Property damage has not been adjusted for inflation.

Source: NFPA Annual Fire Experience Survey and National Fire Incident Reporting System (NFIRS).

tional fire fighter functions and additional responding personnel on the initial full alarm assignment. The NFPA *Fire Protection Handbook* categorizes occupancies in three broad groups:

- (1) High-hazard occupancies: schools, hospitals, nursing homes, explosives plants, refineries, high-rise buildings, and other high life hazard or large fire potential occupancies
- (2) Medium-hazard occupancies: apartments, offices, mercantile, and industrial occupancies not normally requiring extensive rescue or fire-fighting forces
- (3) Low-hazard occupancies: one-, two- or three-family dwellings and scattered small businesses and industrial occupancies. The NFPA 1710 benchmark occupancy fits into this low-hazard category.

In determining the initial responding force to these occupancies, AHJs must consider the additional potential of fire

spread, types of combustibles, increased life hazard, and various tasks that must be accomplished to achieve their mission.

A.5.2.4.5.2 Once units arrive, or a determination is made that other resources are required, additional alarms should be called for and dispatched. Departments should have predetermined procedures for additional alarms. Many departments send the same number and type of units on the second alarm as on the first alarm. Incident commanders can always request unique resources when required. Many departments will only be able to handle additional alarms through automatic or mutual aid agreements that have been previously established.

A.5.3 An EMS system is defined as a comprehensive, coordinated arrangement of resources and functions that are organized to respond in a timely, staged manner to medical emergencies, regardless of their cause. The term *system* can be applied locally or at the state, provincial, or national level. The fundamental functions of an EMS system are the following:

- (1) System organization and management
- (2) Medical direction
- (3) Human resources and training
- (4) Communications
- (5) Emergency response
- (6) Transportation
- (7) Care facilities
- (8) Quality assurance
- (9) Public information and education
- (10) Disaster medical services
- (11) Research
- (12) Special populations

A.5.3.2 The following four functions do not necessarily exist as separate elements in a particular system:

- (1) The first responding unit can be an advanced life support (ALS) ambulance that can provide ALS treatment and ambulance transportation.
- (2) The first responding unit can be a fire suppression unit that can provide both initial and advanced-level medical care.
- (3) ALS can be provided by the ambulance or by an additional fire suppression unit or a unit that is dedicated to ALS response only.
- (4) The system might not have ALS treatment capability — only a fire apparatus with fire fighters trained as first responder AED can respond.

A.5.5.6.2 The U.S. Air Force has defined the areas involved in the emergency within 75 ft (23 m) of the aircraft as immediately dangerous to life and health (IDLH).

A.5.6 For additional information on marine fire fighting, see NFPA 1405.

A.5.6.5.1 For additional information on marine rescue and fire-fighting vessels, see NFPA 1925.

A.5.7.6.1.2 A system developed by Chief Paul Gleason of the United States Forest Service addresses specific mandatory fire orders in a system termed *LCES*, which stands for lookout(s), communication(s), escape route(s), and safety zone(s). These four items are to be implemented as an integrated system by a single resource unit, a strike team, or a full assignment. The implementation of LCES is a minimum safety requirement prior to the initiation of any wildland fire-fighting operations.

A.6.2 Emergency incidents can involve operations that vary considerably in their complexity and scale. The control of

these incidents depends on the planned, systematic implementation of an effective fireground organization to accomplish identified objectives. Every fire department, regardless of size, needs a proper system to regulate and direct emergency forces and equipment at both routine and major incidents. The incident management system forms the basic structure of operations, regardless of scale. An effective system is designed to manage incidents of different types, including structure fires, wildland fires, hazardous materials incidents, and medical and other emergencies.

A.6.2.2 Unlike fire incidents where command is normally predicated by rank structure, EMS patient care is based on statutory recognition of the member with the highest level of medical certification. The recommendation is that departments adopt protocols that define the degree of both member and nonmember involvement in direct patient care based on local standards, medical control, and statutory requirements.

A.6.5 For additional information, see NFPA 1620.

Annex B Community-Wide Risk Management Model

This annex is not a part of the requirements of this NFPA document but is included for information purposes only.

B.1 This model is an example of how a community-wide risk management plan can be used to protect both citizens and property. While NFPA 1710 is scoped to focus strictly on deployment, staffing, and service levels, it is one component of a total community fire protection planning process. An AHJ can determine other components that could reduce the risks of fire and adopt stronger building and fire prevention codes, enforce those more vigorously, and enhance public life safety education components. This model is included for that purpose. Figure B.1 illustrates a fire department process map.

NFPA 1730, Chapter 5 establishes a process to identify and analyze community risks to assist in the development and implementation of a community risk reduction (CRR) plan. Detailed guidance on conducting a CRR plan is provided in Annex B of NFPA 1730.

For other documents on community risk assessment and community risk reduction, see: *Fire Service Deployment: Assessing Community Vulnerability*, Urban Fire Forum; *ISO Fire Suppression Rating Schedule*, CPSE Standard of Cover; *IFE V2020 CRR 2009 Project Report*; *IFE V2020 CRR Symposium Report*; and *Washington Association of State Fire Marshals CRR Project Report*.

B.1.1 This annex addresses the need for fire departments to develop an overall “defense-in-depth” strategy for the delivery of fire services. The development of such a strategy should include an assessment of the tools available to the fire service for accomplishing the goals of fire safety.

B.1.2 Fire safety objectives can be defined as those ideas that a department aspires to deliver. For example, fire department objectives could include such statements as “Maintain injuries and life/property losses as low as reasonably achievable (community and department).” The accomplishment of this objective should not be left to fire-fighting operations alone. See Figure B.1.2 for fire safety concepts.

B.1.3 Fire prevention is not simply preventing fire. It is the systematic application of codes, standard, engineering principles, and an understanding of human behavior to achieve the objective of limiting the loss of life and property.

1710-22 ORGANIZATION AND DEPLOYMENT OF FIRE SUPPRESSION OPERATIONS BY CAREER FIRE DEPARTMENTS



FIGURE B.1 Fire Department Process Map.

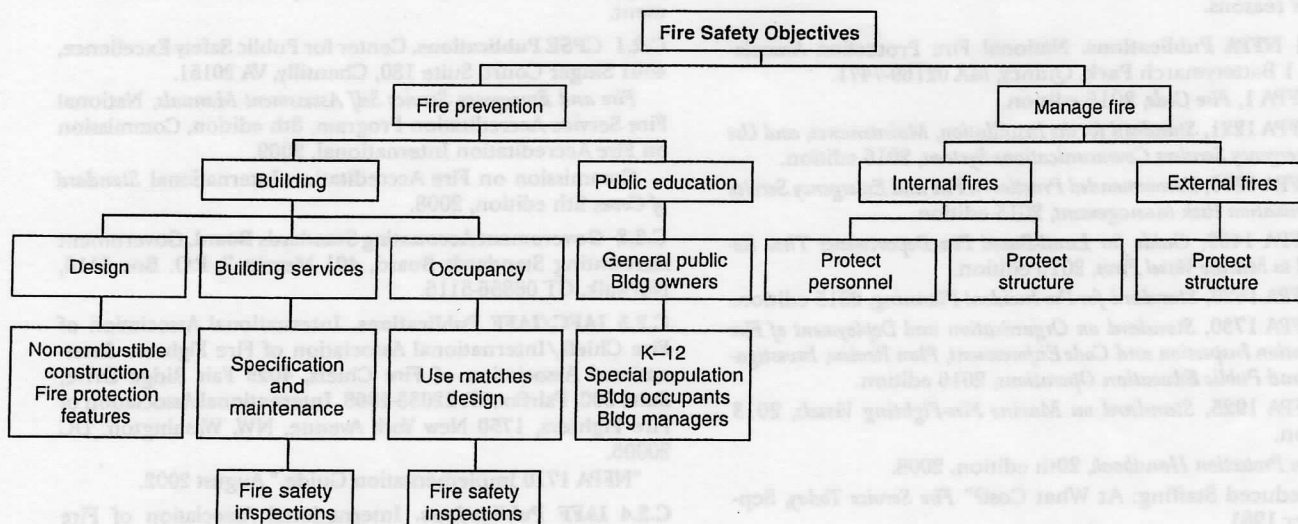


FIGURE B.1.2 Fire Safety Concepts for Fire Department Operations.

B.1.3.1 As outlined in NFPA 1, fire prevention includes egress, construction design, building services, fire protection, and occupancy. All of these elements work together to provide the occupants and fire department personnel with a level of fire safety not otherwise available.

B.1.3.2 By ensuring that each of these elements is balanced, the fire department can maintain a reasonable level of risk for the community and the department.

B.1.3.3 To provide risk management, the fire department must utilize all of the tools available. In order of preference, those tools are as follows:

- (1) Fire-safe design and construction
- (2) Suppression systems
- (3) Detection systems
- (4) Occupant fire prevention practices
- (5) Fire department-conducted fire-safety inspections
- (6) Fire rescue response

B.1.3.4 A structure designed and constructed to withstand the effects of fire is the most important asset in achieving fire risk management. A structure relying solely on fire rescue response offers the greatest challenge to the occupants and fire department personnel.

B.1.4 Fire impact management is the ability to manage the impact of a fire on occupants and structures. The participation of the fire department in the design, construction, maintenance, and use of a structure provides defense-in-depth against fire losses.

B.1.4.1 Structures that are designed with noncombustible construction, are protected with fire protection systems, and are routinely inspected to ensure appropriate occupant use are most likely to provide the lowest risk levels and therefore are the least difficult to manage.

B.1.4.2 Fire-fighting operations on fully compliant structures for which the fire fighters know the occupancy conditions can be conducted with a plan that commits resources only as necessary to accomplish the pre-established goals.

B.1.4.3 Pre-established goals for each structure define the commitment of resources in order to limit risk to occupants, the structure, and fire department personnel.

Annex C Informational References

C.1 Referenced Publications. The documents or portions thereof listed in this annex are referenced within the informational sections of this standard and are not part of the requirements of this document unless also listed in Chapter 2 for other reasons.

C.1.1 NFPA Publications. National Fire Protection Association, 1 Batterymarch Park, Quincy, MA 02169-7471.

NFPA 1, *Fire Code*, 2015 edition.

NFPA 1221, *Standard for the Installation, Maintenance, and Use of Emergency Services Communications Systems*, 2016 edition.

NFPA 1250, *Recommended Practice in Fire and Emergency Service Organization Risk Management*, 2015 edition.

NFPA 1405, *Guide for Land-Based Fire Departments That Respond to Marine Vessel Fires*, 2016 edition.

NFPA 1620, *Standard for Pre-Incident Planning*, 2015 edition.

NFPA 1730, *Standard on Organization and Deployment of Fire Prevention Inspection and Code Enforcement, Plan Review, Investigation, and Public Education Operations*, 2016 edition.

NFPA 1925, *Standard on Marine Fire-Fighting Vessels*, 2013 edition.

Fire Protection Handbook, 20th edition, 2008.

"Reduced Staffing: At What Cost?" *Fire Service Today*, September 1981.

C.1.2 Other Publications.

C.1.2.1 AMA Publications. American Medical Association, 515 North State Street, Chicago, IL 60610.

"Guidelines 2000 for Cardiopulmonary Resuscitation and Emergency Cardiac Care." 1992. *Journal of the American Medical Association*, 268(16) (October 28).

C.1.2.2 FEMA Publications. Federal Emergency Management Agency, 500 C Street, S.W., Washington, DC 20472.

"Fire Risk Analysis: A Systems Approach," NFA-SM-FRAS, National Emergency Training Center, National Fire Academy, July 20, 1984.

C.1.2.3 NIST Publications. National Institute of Standards and Technology, 100 Bureau Drive, Bldg. 820, Rm. 164, Gaithersburg, MD 20899.

"Hazard I Fire Hazard Assessment Method," U.S. Department of Commerce, June 1991.

"Report on High-Rise Fireground Field Experiments," April 2013.

C.1.2.4 U.S. Government Publications. U.S. Government Publishing Office, Washington, DC 20402.

Title 42, U.S. Code, Chapter 116, Emergency Planning and Community Right-to-Know Act, 1986.

C.1.2.5 Other Publications. "Basic Trauma Life Support for Paramedics and Other Providers," American College of Emergency Physicians, John Campbell (ed), 1997.

Shaping the Future of Fire Ground Staffing and Delivery Systems within a Comprehensive Fire Safety Effectiveness Model, Office of the Ontario Fire Marshal, 1993.

"Pre-Hospital Trauma Life Support," American College of Surgeons, Paturaas, Wertz and McSwain (eds), 1999.

"Pediatric Advanced Life Support," American Heart Association, Besson (ed), 1997.

"Fire Department Evaluation System (FIREDAP)," Phoenix, AZ Fire Department, December 1991.

"Emergency Care and Transportation of the Sick and Injured," American Association of Orthopedic Surgeons, Browner (ed), 1999.

C.2 Informational References. The following documents or portions thereof are listed here as informational resources only. They are not a part of the requirements of this document.

C.2.1 CPSE Publications. Center for Public Safety Excellence, 4501 Singer Court, Suite 180, Chantilly, VA 20151.

Fire and Emergency Service Self Assessment Manuals, National Fire Service Accreditation Program. 8th edition, Commission on Fire Accreditation International, 2009.

Commission on Fire Accreditation International *Standard of Cover*, 5th edition, 2008.

C.2.2 Government Accounting Standards Board. Government Accounting Standards Board, 401 Merritt 7, P.O. Box 5116, Norwalk, CT 06856-5116.

C.2.3 IAFC/IAFF Publications. International Association of Fire Chiefs/International Association of Fire Fighters. International Association of Fire Chiefs, 4025 Fair Ridge Drive, Suite 300, Fairfax, VA 22033-2868. International Association of Fire Fighters, 1750 New York Avenue, NW, Washington, DC 20006.

"NFPA 1710 Implementation Guide," August 2002.

C.2.4 IAFF Publications. International Association of Fire Fighters, 1750 New York Avenue, NW, Washington, DC 20006.

Department of Research and Labor Issues, "Effectiveness of Fire-Based EMS," 1995.

Department of Research and Labor Issues, "Safe Fire Fighting Staffing," 1993.

Department of Emergency Medical Services, "Emergency Medical Services Performance Objectives," 2002.

C.2.5 IFSTA/FPP Publications. IFSTA/FPP, 930 N. Willis, Stillwater, OK 74078.

"Systems Approach to Managing Fire and Life Safety Services," Dennis Compton.

C.2.6 Insurance Services Office Publications. ISO Customer Service Division, 545 Washington Blvd., Jersey City, NJ 07310-1686.

"Public Protection Classification Service"; Fire Suppression Rating Schedule.

1710-24 ORGANIZATION AND DEPLOYMENT OF FIRE SUPPRESSION OPERATIONS BY CAREER FIRE DEPARTMENTS

C.2.7 International City/County Management Association Publications. 777 N. Capitol Street, Washington, DC 20022.

"Managing Fire and Rescue Services," June 2002.

"Interim Report of the Tricom Consortium."

C.2.8 U.S. Government Publications. U.S. Government Publishing Office, Washington, DC 20402.

Title 29, Code of Federal Regulations, Part 1910.120, "Hazardous Waste Operations and Emergency Response," 1986.

Title 29, Code of Federal Regulations, Part 1910.156, "Fire Brigades," 1998.

C.2.9 Other Publications. "Guidelines 2000 for Cardiopulmonary Resuscitation and Emergency Cardiac Care," JAMA, August 2000.

"Performance Measurement and Benchmarking Project," Office of the Ontario Fire Marshal, 2003.

C.3 References for Extracts in Informational Sections. NFPA 1500, *Standard on Fire Department Occupational Safety and Health Program*, 2013 edition.

Index

Copyright © 2015 National Fire Protection Association. All Rights Reserved.

The copyright in this index is separate and distinct from the copyright in the document that it indexes. The licensing provisions set forth for the document are not applicable to this index. This index may not be reproduced in whole or in part by any means without the express written permission of NFPA.

-A-		-E-	
Administration.....	Chap. 1	Emergency Incident	
Application.....	1.3	Definition.....	3.3.16
Equivalency.....	1.4, A.1.4	Emergency Medical Care	
Purpose.....	1.2	Definition.....	3.3.17
Scope.....	1.1, A.1.1	Emergency Operations	
Advanced Life Support (ALS)		Definition.....	3.3.18
Definition.....	3.3.1	Evaluations.....	4.1.2.5
Aid		Explanatory Material.....	Annex A
Automatic Aid		-F-	
Definition.....	3.3.2.1, A.3.3.2.1	Fire Apparatus	
Definition.....	3.3.2	Definition.....	3.3.19
Mutual Aid		Fire Department Member	
Definition.....	3.3.2.2	Definition.....	3.3.20
Aircraft Rescue and Fire Fighting		Fire Department Services.....	Chap. 5
Definition.....	3.3.3	Airport Rescue and Fire-Fighting (ARFF) Services.....	5.5
Aircraft Rescue and Fire-Fighting (ARFF) Vehicle		Deployment.....	5.5.4
Definition.....	3.3.4, A.3.3.4	Emergency Operations.....	5.5.6
Alarm		Incident Safety Officer.....	5.5.6.4
Definition.....	3.3.5, A.3.3.5	Staffing.....	5.5.5
Alarm Answering Time		Emergency Medical Services (EMS).....	5.3, A.5.3
Definition.....	3.3.6	EMS System Functions.....	5.3.3
Alarm Handling.....	4.1.2.3	Service Delivery Deployment.....	5.3.3.3
Alarm Handling Time		Staffing.....	5.3.3.2
Definition.....	3.3.7	Quality Management.....	5.3.4
Alarm Processing Time		Fire Department Medical Personnel Review.....	5.3.4.2
Definition.....	3.3.8	Medical Director Review.....	5.3.4.3
Alarm Transfer Time		System Components.....	5.3.2, A.5.3.2
Definition.....	3.3.9	Training Levels.....	5.3.2.2
Apparatus		Treatment Levels.....	5.3.2.1
Definition.....	3.3.10	Fire Suppression Services.....	5.2, A.5.2
Fire Apparatus		Deployment.....	5.2.4
Definition.....	3.3.10.1	Additional Alarm Assignments.....	5.2.4.5
Quint Apparatus		Apartment Initial Full Alarm Assignment	
Definition.....	3.3.10.2	Capability.....	5.2.4.3
Specialized Apparatus		High-Rise Initial Full Alarm Assignment	
Definition.....	3.3.10.3	Capability.....	5.2.4.4, A.5.2.4.4
Approved		Open-Air Strip Shopping Center Initial Full Alarm	
Definition.....	3.2.1, A.3.2.1	Assignment Capability.....	5.2.4.2
Authority Having Jurisdiction (AHJ)		Single-Family Dwelling Initial Full Alarm Assignment	
Definition.....	3.2.2, A.3.2.2	Capability.....	5.2.4.1
Automatic Aid		Fire Suppression Capability.....	5.2.1
Definition.....	3.3.11	Operating Units.....	5.2.3
-B-		Fire Companies with Quint Apparatus.....	5.2.3.4
Basic Life Support (BLS)		Other Types of Companies.....	5.2.3.3
Definition.....	3.3.12	Staffing.....	5.2.2, A.5.2.2
-C-		Marine Rescue and Fire-Fighting (MRFF)	
Community-Wide Risk Management Model.....	Annex B	Services.....	5.6, A.5.6
Company		Operating Units.....	5.6.5
Definition.....	3.3.13, A.3.3.13	Response Plan.....	5.6.2
Company Officer		Staffing.....	5.6.4
Definition.....	3.3.14	Numbers of On-Duty Marine Personnel.....	5.6.4.1
Crew		Organization of On-Duty Members.....	5.6.4.2
Definition.....	3.3.15	Purpose.....	5.1
-D-		Special Operations Response.....	5.4
Definitions.....	Chap. 3	Wildland Fire Suppression Services.....	5.7
		Deployment.....	5.7.6
		Direct Attack.....	5.7.6.2
		Indirect Attack.....	5.7.6.3
		Required Number of Vehicles.....	5.7.6.1
		Non-Wildland Emergencies.....	5.7.7

1710-26 ORGANIZATION AND DEPLOYMENT OF FIRE SUPPRESSION OPERATIONS BY CAREER FIRE DEPARTMENTS

Operating Units.....	5.7.5	Incident Safety Officer	
Other Types of Companies	5.7.5.3	Definition	3.3.40.2
Organization	5.7.2	Supervisory Chief Officer	
Staffing.....	5.7.4	Definition	3.3.40.3, A.3.3.40.3
Fire Fighting		Operations	
Aircraft Rescue and Fire Fighting		Definition	3.3.41
Definition	3.3.21.1, A.3.3.21.1	Emergency Operations	
Definition	3.3.21	Definition	3.3.41.1
Marine Rescue and Fire Fighting		Special Operations	
Definition	3.3.21.2, A.3.3.21.2	Definition	3.3.41.2, A.3.3.41.2
Structural Fire Fighting		Organization	Chap. 4
Definition	3.3.21.3	Airport Rescue and Fire-Fighting Services.....	4.5
Fire Protection		Emergency Medical Services.....	4.3
Definition	3.3.22	Fire Department Organizational Statement.....	4.1
Fire Suppression		Fire Suppression Services	4.2
Definition	3.3.23, A.3.3.23	Intercommunity Organization.....	4.8
First Responder (EMS)		Marine Rescue and Fire-Fighting Services.....	4.6
Definition.....	3.3.24, A.3.3.24	Special Operations.....	4.4
Forcible Entry		Wildland Fire Suppression Services	4.7
Definition	3.3.25		
		-P-	
-H-		Public Safety Answering Point (PSAP)	
Hazard		Definition	3.3.42
Definition.....	3.3.26, A.3.3.26		
Hazardous Material		-Q-	
Definition	3.3.27	Quint Apparatus	
High-Hazard Occupancy		Definition	3.3.43
Definition.....	3.3.28, A.3.3.28		
		-R-	
-I-		Rapid Intervention Crew (RIC)	
Incident Commander		Definition.....	3.3.44, A.3.3.44
Definition	3.3.29	Initial Rapid Intervention Crew (IRIC)	
Incident Management System (IMS)		Definition	3.3.44.1
Definition.....	3.3.30, A.3.3.30	Referenced Publications	Chap. 2
Incident Safety Officer		General	2.1
Definition	3.3.31	NFPA Publications	2.2
Informational References	Annex C	Other Publications.....	2.3
Initial Full Alarm Assignment		References for Extracts in Mandatory Sections	2.4
Definition	3.3.32	Rescue	
Initial Rapid Intervention Crew (IRIC)		Definition	3.3.45
Definition	3.3.33		
Initiating Action/Intervention Time		-S-	
Definition	3.3.34	Shall	
Intergovernmental Agreement		Definition.....	3.2.3
Definition	3.3.35	Should	
		Definition.....	3.2.4
-L-		Special Operations	
Life Support		Definition	3.3.46
Advanced Life Support (ALS)		Specialized Apparatus	
Definition	3.3.36.1	Definition	3.3.47
Basic Life Support (BLS)		Staff Aide	
Definition	3.3.36.2, A.3.3.36.2	Definition.....	3.3.48, A.3.3.48
Definition	3.3.36	Standard	
		Definition.....	3.2.5
-M-		Standard Operating Procedure	
Marine Rescue and Fire Fighting		Definition	3.3.49
Definition	3.3.37	Structural Fire Fighting	
Member		Definition	3.3.50
Definition.....	3.3.38, A.3.3.38	Supervisory Chief Officer	
Mutual Aid		Definition	3.3.51
Definition	3.3.39	Systems	Chap. 6
		Communications Systems	6.4
-O-		Incident Management System	6.2, A.6.2
Officer		Pre-Incident Planning	6.5, A.6.5
Company Officer		Safety and Health System	6.1
Definition	3.3.40.1, A.3.3.40.1	Training Systems	6.3
Definition	3.3.40		
		-T-	
		Team	
		Definition	3.3.52



Time

Alarm Answering Time	
Definition	3.3.53.1
Alarm Handling Time	
Definition	3.3.53.2
Alarm Processing Time	
Definition	3.3.53.3
Alarm Transfer Time	
Definition	3.3.53.4
Definition	3.3.53
Initiating Action/Intervention Time	
Definition	3.3.53.5, A.3.3.53.5

Total Response Time

Definition	3.3.53.6, A.3.3.53.6
Travel Time	
Definition	3.3.53.7
Turnout Time	
Definition	3.3.53.8
Total Response Time	
Definition	3.3.54
Travel Time	
Definition	3.3.55
Turnout Time	
Definition	3.3.56

Sequence of Events for the Standards Development Process

As soon as the current edition is published, a Standard is open for Public Input

Step 1: Input Stage

- Input accepted from the public or other committees for consideration to develop the First Draft
- Committee holds First Draft Meeting to revise Standard (23 weeks)
- Committee(s) with Correlating Committee (10 weeks)
- Committee ballots on First Draft (12 weeks)
- Committee(s) with Correlating Committee (11 weeks)
- Correlating Committee First Draft Meeting (9 weeks)
- Correlating Committee ballots on First Draft (5 weeks)
- First Draft Report posted

Step 2: Comment Stage

- Public Comments accepted on First Draft (10 weeks)
- If Standard does not receive Public Comments and the Committee does not wish to further revise the Standard, the Standard becomes a Consent Standard and is sent directly to the Standards Council for issuance
- Committee holds Second Draft Meeting (21 weeks)
- Committee(s) with Correlating Committee (7 weeks)
- Committee ballots on Second Draft (11 weeks)
- Committee(s) with Correlating Committee (10 weeks)
- Correlating Committee First Draft Meeting (9 weeks)
- Correlating Committee ballots on First Draft (8 weeks)
- Second Draft Report posted

Step 3: Association Technical Meeting

- Notice of Intent to Make a Motion (NITMAM) accepted (5 weeks)
- NITMAMs are reviewed and valid motions are certified for presentation at the Association Technical Meeting
- Consent Standard bypasses Association Technical Meeting and proceeds directly to the Standards Council for issuance
- NFPA membership meets each June at the Association Technical Meeting and acts on Standards with "Certified Amending Motions" (certified NITMAMs)
- Committee(s) and Panel(s) vote on any successful amendments to the Technical Committee Reports made by the NFPA membership at the Association Technical Meeting

Step 4: Council Appeals and Issuance of Standard

- Notification of intent to file an appeal to the Standards Council on Association action must be filed within 20 days of the Association Technical Meeting
- Standards Council decides, based on all evidence, whether or not to issue the Standards or to take other action

Committee Membership Classifications^{1,2,3,4}

The following classifications apply to Committee members and represent their principal interest in the activity of the Committee.

1. M *Manufacturer*: A representative of a maker or marketer of a product, assembly, or system, or portion thereof, that is affected by the standard.
2. U *User*: A representative of an entity that is subject to the provisions of the standard or that voluntarily uses the standard.
3. IM *Installer/Maintainer*: A representative of an entity that is in the business of installing or maintaining a product, assembly, or system affected by the standard.
4. L *Labor*: A labor representative or employee concerned with safety in the workplace.
5. RT *Applied Research/Testing Laboratory*: A representative of an independent testing laboratory or independent applied research organization that promulgates and/or enforces standards.
6. E *Enforcing Authority*: A representative of an agency or an organization that promulgates and/or enforces standards.
7. I *Insurance*: A representative of an insurance company, broker, agent, bureau, or inspection agency.
8. C *Consumer*: A person who is or represents the ultimate purchaser of a product, system, or service affected by the standard, but who is not included in (2).
9. SE *Special Expert*: A person not representing (1) through (8) and who has special expertise in the scope of the standard or portion thereof.

NOTE 1: "Standard" connotes code, standard, recommended practice, or guide.

NOTE 2: A representative includes an employee.

NOTE 3: While these classifications will be used by the Standards Council to achieve a balance for Technical Committees, the Standards Council may determine that new classifications of member or unique interests need representation in order to foster the best possible Committee deliberations on any project. In this connection, the Standards Council may make such appointments as it deems appropriate in the public interest, such as the classification of "Utilities" in the National Electrical Code Committee.

NOTE 4: Representatives of subsidiaries of any group are generally considered to have the same classification as the parent organization.

Submitting Public Input / Public Comment through the Electronic Submission System (e-Submission):

As soon as the current edition is published, a Standard is open for Public Input.

Before accessing the e-Submission System, you must first sign-in at www.NFPA.org. *Note: You will be asked to sign-in or create a free online account with NFPA before using this system:*

- a. Click in the gray Sign In box on the upper left side of the page. Once signed-in, you will see a red "Welcome" message in the top right corner.
- b. Under the Codes and Standards heading, Click on the Document Information pages (List of Codes & Standards), and then select your document from the list or use one of the search features in the upper right gray box.

OR

- a. Go directly to your specific document page by typing the convenient short link of www.nfpa.org/document#, (Example: NFPA 921 would be www.nfpa.org/921) Click in the gray Sign In box on the upper left side of the page. Once signed in, you will see a red "Welcome" message in the top right corner.

To begin your Public Input, select the link The next edition of this standard is now open for Public Input (formally "proposals") located on the Document Information tab, the Next Edition tab, or the right-hand Navigation bar. Alternatively, the Next Edition tab includes a link to Submit Public Input online

At this point, the NFPA Standards Development Site will open showing details for the document you have selected. This "Document Home" page site includes an explanatory introduction, information on the current document phase and closing date, a left-hand navigation panel that includes useful links, a document Table of Contents, and icons at the top you can click for Help when using the site. The Help icons and navigation panel will be visible except when you are actually in the process of creating a Public Input.

Once the First Draft Report becomes available there is a Public comment period during which anyone may submit a Public Comment on the First Draft. Any objections or further related changes to the content of the First Draft must be submitted at the Comment stage.

To submit a Public Comment you may access the e-Submission System utilizing the same steps as previous explained for the submission of Public Input.

For further information on submitting public input and public comments, go to: <http://www.nfpa.org/publicinput>

Other Resources available on the Doc Info Pages

Document information tab: Research current and previous edition information on a Standard

Next edition tab: Follow the committee's progress in the processing of a Standard in its next revision cycle.

Technical committee tab: View current committee member rosters or apply to a committee

Technical questions tab: For members and Public Sector Officials/AHJs to submit questions about codes and standards to NFPA staff. Our Technical Questions Service provides a convenient way to receive timely and consistent technical assistance when you need to know more about NFPA codes and standards relevant to your work. Responses are provided by NFPA staff on an informal basis.

Products/training tab: List of NFPA's publications and training available for purchase.

Community tab: Information and discussions about a Standard

Information on the NFPA Standards Development Process

I. Applicable Regulations. The primary rules governing the processing of NFPA standards (codes, standards, recommended practices, and guides) are the *NFPA Regulations Governing the Development of NFPA Standards (Regs)*. Other applicable rules include *NFPA Bylaws*, *NFPA Technical Meeting Convention Rules*, *NFPA Guide for the Conduct of Participants in the NFPA Standards Development Process*, and the *NFPA Regulations Governing Petitions to the Board of Directors from Decisions of the Standards Council*. Most of these rules and regulations are contained in the *NFPA Standards Directory*. For copies of the *Directory*, contact Codes and Standards Administration at NFPA Headquarters; all these documents are also available on the NFPA website at "www.nfpa.org."

The following is general information on the NFPA process. All participants, however, should refer to the actual rules and regulations for a full understanding of this process and for the criteria that govern participation.

II. Technical Committee Report. The Technical Committee Report is defined as "the Report of the responsible Committee(s), in accordance with the Regulations, in preparation of a new or revised NFPA Standard." The Technical Committee Report is in two parts and consists of the First Draft Report and the Second Draft Report. (See *Regs* at 1.4)

III. Step 1: First Draft Report. The First Draft Report is defined as "Part one of the Technical Committee Report, which documents the Input Stage." The First Draft Report consists of the First Draft, Public Input, Committee Input, Committee and Correlating Committee Statements, Correlating Input, Correlating Notes, and Ballot Statements. (See *Regs* at 4.2.5.2 and Section 4.3) Any objection to an action in the First Draft Report must be raised through the filing of an appropriate Comment for consideration in the Second Draft Report or the objection will be considered resolved. [See *Regs* at 4.3.1(b)]

IV. Step 2: Second Draft Report. The Second Draft Report is defined as "Part two of the Technical Committee Report, which documents the Comment Stage." The Second Draft Report consists of the Second Draft, Public Comments with corresponding Committee Actions and Committee Statements, Correlating Notes and their respective Committee Statements, Committee Comments, Correlating Revisions, and Ballot Statements. (See *Regs* at Section 4.2.5.2 and 4.4) The First Draft Report and the Second Draft Report together constitute the Technical Committee Report. Any outstanding objection following the Second Draft Report must be raised through an appropriate Amending Motion at the Association Technical Meeting or the objection will be considered resolved. [See *Regs* at 4.4.1(b)]

V. Step 3a: Action at Association Technical Meeting. Following the publication of the Second Draft Report, there is a period during which those wishing to make proper Amending Motions on the Technical Committee Reports must signal their intention by submitting a Notice of Intent to Make a Motion. (See *Regs* at 4.5.2) Standards that receive notice of proper Amending Motions (Certified Amending Motions) will be presented for action at the annual June Association Technical Meeting. At the meeting, the NFPA membership can consider and act on these Certified Amending Motions as well as Follow-up Amending Motions, that is, motions that become necessary as a result of a previous successful Amending Motion. (See 4.5.3.2 through 4.5.3.6 and Table 1, Columns 1-3 of *Regs* for a summary of the available Amending Motions and who may make them.) Any outstanding objection following action at an Association Technical Meeting (and any further Technical Committee consideration following successful Amending Motions, see *Regs* at 4.5.3.7 through 4.6.5.3) must be raised through an appeal to the Standards Council or it will be considered to be resolved.

VI. Step 3b: Documents Forwarded Directly to the Council. Where no Notice of Intent to Make a Motion (NITMAM) is received and certified in accordance with the Technical Meeting Convention Rules, the standard is forwarded directly to the Standards Council for action on issuance. Objections are deemed to be resolved for these documents. (See *Regs* at 4.5.2.5)

VII. Step 4a: Council Appeals. Anyone can appeal to the Standards Council concerning procedural or substantive matters related to the development, content, or issuance of any document of the Association or on matters within the purview of the authority of the Council, as established by the *Bylaws* and as determined by the Board of Directors. Such appeals must be in written form and filed with the Secretary of the Standards Council (See *Regs* at 1.6). Time constraints for filing an appeal must be in accordance with 1.6.2 of the *Regs*. Objections are deemed to be resolved if not pursued at this level.

VIII. Step 4b: Document Issuance. The Standards Council is the issuer of all documents (see Article 8 of *Bylaws*). The Council acts on the issuance of a document presented for action at an Association Technical Meeting within 75 days from the date of the recommendation from the Association Technical Meeting, unless this period is extended by the Council (See *Regs* at 4.7.2). For documents forwarded directly to the Standards Council, the Council acts on the issuance of the document at its next scheduled meeting, or at such other meeting as the Council may determine (See *Regs* at 4.5.2.5 and 4.7.4).

IX. Petitions to the Board of Directors. The Standards Council has been delegated the responsibility for the administration of the codes and standards development process and the issuance of documents. However, where extraordinary circumstances requiring the intervention of the Board of Directors exist, the Board of Directors may take any action necessary to fulfill its obligations to preserve the integrity of the codes and standards development process and to protect the interests of the Association. The rules for petitioning the Board of Directors can be found in the *Regulations Governing Petitions to the Board of Directors from Decisions of the Standards Council* and in 1.7 of the *Regs*.

X. For More Information. The program for the Association Technical Meeting (as well as the NFPA website as information becomes available) should be consulted for the date on which each report scheduled for consideration at the meeting will be presented. For copies of the First Draft Report and Second Draft Report as well as more information on NFPA rules and for up-to-date information on schedules and deadlines for processing NFPA documents, check the NFPA website (www.nfpa.org/aboutthecodes) or contact NFPA Codes & Standards Administration at (617) 984-7246.



STAY UP-TO-DATE. JOIN NFPA® TODAY!

☒ **YES** Please enroll me as a member of NFPA for the term checked below. Activate all benefits, and ship my *Member Kit* including the *Benefits Guide* and other resources to help me make the most of my NFPA membership. Please allow three to four weeks for the kit to arrive.

BILLING INFORMATION:

Name _____ Title _____
Organization _____
Address _____
City _____ State _____ Zip/Postal Code _____
Country _____
Phone _____ E-mail _____

Priority Code: 8J-MIS-12

PLEASE ANSWER THE FOLLOWING QUESTIONS:

Job Title (check one)

- ☒ Architect, Engineer, Consultant, Contractor (C17)
☐ Facilities Safety Officer (F14)
☐ Fire Chief, Other Fire Service (A11)
☐ Loss Control, Risk Manager (L11)
☐ Inspector, Building Official, Fire Marshal (F03)
☐ Owner, President, Manager, Administrator (C10)
☐ Other (please specify): (G11) _____

Type of Organization (check one)

- ☐ Architecture, Engineering, Contracting (A14)
☐ Commercial Firm (Office, Retail, Lodging, Restaurant) (G13)
☐ Electrical Services, Installation (J11)
☐ Fire Service, Public and Private (AA1)
☐ Government (C12)
☐ Industrial Firm (Factory, Warehouse) (C11)
☐ Institutional (Health Care, Education, Detention, Museums) (B11)
☐ Insurance, Risk Management (B12)
☐ Utilities (G12)
☐ Other (please specify): (G11) _____

4 EASY WAYS TO JOIN

Mail: 1-800-593-6372, Outside the U.S. +1-508-895-8301
NFPA Membership Services Center,
11 Tracy Drive, Avon, MA 02322-9908
Online: nfpa.org
Call: 1-800-344-3555
Outside the U.S. call +1-617-770-3000

12/14-D

TERMS AND PAYMENT:

- ☐ 1 year (\$165)
☐ 2 years (\$300) **SAVE \$30**
☐ 3 years (\$430) **SAVE \$65**

Annual membership dues include a \$45 subscription to *NFPA Journal*®. Regular membership in NFPA is individual and non-transferable. NFPA Journal is a registered trademark of the National Fire Protection Association, Quincy, MA 02169. Voting privileges begin after 180 days of individual membership. Prices subject to change.

PAYMENT METHOD:

Check One:

- ☐ Payment Enclosed (Make check payable to NFPA.)
☐ Purchase Order (Please attach this form to your P.O.)
☐ Bill Me Later (Not available on International memberships.)

Charge My: ☐ VISA ☐ MasterCard ☐ AmEx ☐ Discover

Card # _____

Expiration Date _____

Name on Card _____

Signature _____

International members: Please note prepayment is required on all International orders. Be sure to enclose a check or select your preferred credit card option.

100% MONEY-BACK GUARANTEE

If anytime during your first year you decide membership is not for you, let us know and you'll receive a 100% refund of your dues.



"Member-Only" Benefits Keeps You Up-To-Date!

FREE! Technical Support — Technical Support by Phone/Email. Get fast, reliable answers to all code-related questions—from electrical safety for employee workplaces to carbon dioxide extinguishing systems—from NFPA's team of fire protection specialists.

NFPA Journal® — THE journal of record for fire protection, this bi-monthly publication will keep you abreast of the latest fire prevention and safety practices, as well as new technologies and strategies for protecting life and property from fire.

NFPA Update — This easy-to-read monthly e-newsletter will keep you up-to-date on important association programs such as the annual meeting; bring you times of interest from NFPA's regional offices; and alert you to nationwide events and opportunities you won't want to miss.

NFPA News — From new standards for dry cleaning plants to warning equipment for household carbon monoxide, this monthly online update keeps you abreast of additions of changes that could impact how you do your work.

NFPA Standards Directory — The NFPA Standards Directory is your complete guide to NFPA's code-making process. Simply access your online NFPA member profile for document revision guidelines, the revision cycle schedule, and forms for submitting Proposals and Comments. Your online NFPA member profile and access to the NFPA Standards Directory is automatically generated once you join NFPA.

FREE! Section Membership — Share YOUR expertise with others in any of 16 industry-specific sections covering your own field of interest.

Member Kit — Includes Membership Certificate, Pin, Decals, ID Card, and Camera-ready Logo Art. Display the NFPA member logo proudly on your business correspondence, literature, website, and vehicles.

10% Discounts — Save hundreds of dollars each year on the many products and services listed in the NFPA Catalog, including codes and standards publications, handbooks, training videos, and other education materials to increase your knowledge and skills.

Voting Rights — Your chance to help shape the future direction of fire prevention codes and standards. Voting rights go into effect 180 days from the start of individual membership.

Conference Invitation — Invitation to the NFPA Conference and Expo. Attend this important meeting at discounted rates as a member of NFPA.

Join NFPA today!
www.nfpa.org

NFPA® and NFPA Journal® are registered trademarks of the National Fire Protection Association, Quincy, MA 02169-7471